



Pietro Cambiaso
Acting Director of Planning & Resources

Todd Corbin
General Manager

August 15, 2026

Regional Water Quality Control Board, Santa Ana Region

Attention: Mr. Eric Lindberg

3737 Main Street, Suite 500
Riverside, California 92501-3348

**Subject: Chino Basin Recycled Water Groundwater Recharge Program:
Quarterly Monitoring Report for April through June 2026**

Dear Mr. Lindberg,

Inland Empire Utilities Agency and Chino Basin Watermaster hereby submit the *Quarterly Monitoring Report* for the second quarter of 2026 (2Q26), April 1 through June 30, 2026, for the *Chino Basin Recycled Water Groundwater Recharge Program*. This document is submitted pursuant to requirements in Order No. R8-2007-0039. All required monitoring and reporting for the quarter are presented in the attached report. During 2Q26, the Groundwater Recharge Program complied with all monitoring and reporting requirements, except for exceedances of one primary MCL sample for perfluorooctanoic acid (PFOA) and the secondary MCL for odor.

Chino Basin Watermaster hereby certifies that, during the period of April 1 through June 30, 2026, there was no reported pumping for drinking water purposes in the buffer zones extending 500 feet laterally and 6 months underground travel time from each of the recharge sites using recycled water, namely 7th & 8th Street, Banana, Brooks, Declez, Ely, Hickory, RP3, San Sevaime, Turner, and Victoria Basins. In fact, there are no domestic or municipal production wells in the buffer zones of the aforementioned recharge sites.

DECLARATION

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments thereto; and that, based on my inquiry of the individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.

Executed on the 15th day of August in the Cities of Chino and Rancho Cucamonga.

Pietro Cambiaso, P.E.
Acting Director of Planning & Resources


Todd Corbin
General Manager

Inland Empire Utilities Agency
P.O. Box 9020
Chino Hills, CA 91708
909.993.1740

Chino Basin Watermaster
9641 San Bernardino Road
Rancho Cucamonga, CA 91730
909.484.3888

Chino Basin Recycled Water Groundwater Recharge Program

Quarterly Monitoring Report April 1 through June 30, 2026

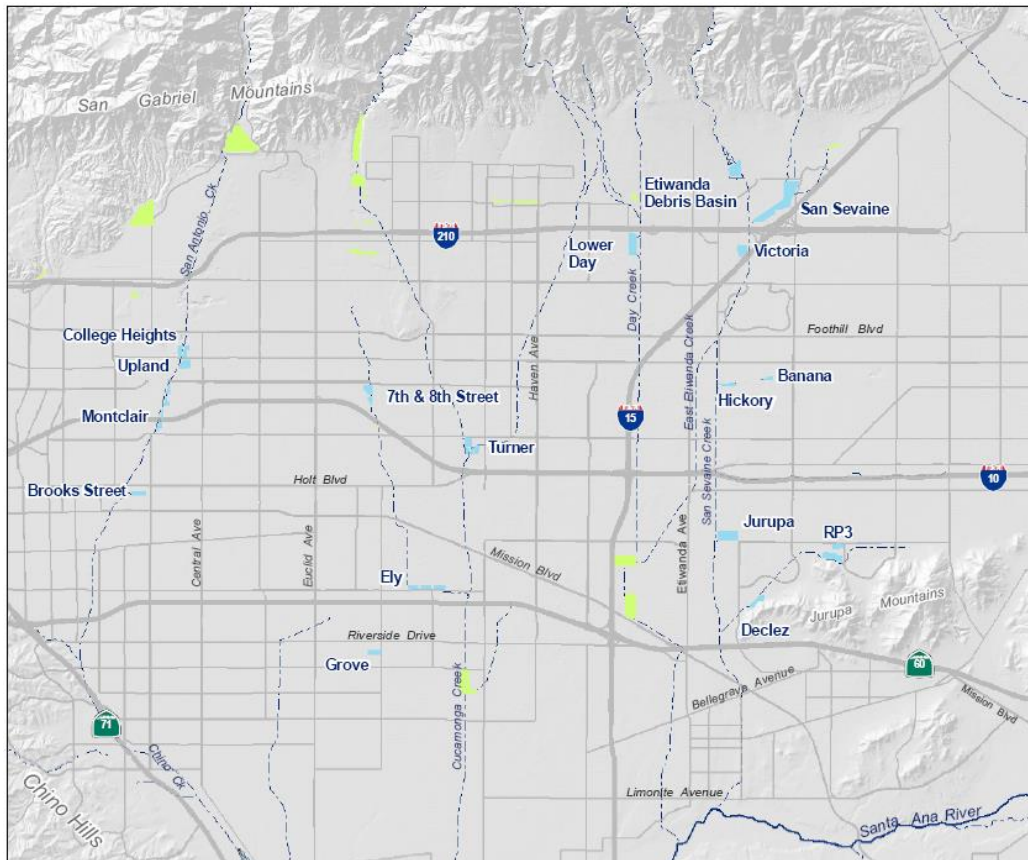

Prepared by:



August 15, 2026

Table of Contents

1. Introduction	1
<i>A. Order No. R8-2007-0039</i>	<i>1</i>
<i>B. Order No. R8-2009-0057</i>	<i>1</i>
<i>C. Revised Monitoring & Reporting Program No. R8-2007-0039</i>	<i>1</i>
<i>D. Title 22, Division 4, Chapter 3. Article 5.1 §60320.100</i>	<i>2</i>
<i>E. Outline of the Quarterly Report</i>	<i>2</i>
2. Monitoring Results.....	2
<i>A. Recycled Water: RP-1 and RP-4</i>	<i>2</i>
<i>B. Recycled Water: Alternative Monitoring Plans for TOC and TN</i>	<i>5</i>
<i>C. Diluent Water</i>	<i>7</i>
<i>D. Groundwater Monitoring Wells</i>	<i>7</i>
3. Recharge Operations	9
4. Operational Problems & Preventive or Corrective Actions	9
5. Certification of Non-Pumping in the Buffer Zones	9
6. MVWD ASR Project	10
7. Exceedance Summary Table	10

LIST OF TABLES

2-1a 2-1b 2-1c	Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality (Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)
2-2	Recycled Water Monitoring: Agency-Wide Flow-Weighted TIN & TDS (Recycled Water Quality Specifications A.6)
2-3a 2-3b	Recycled Water Monitoring: Primary & Secondary Maximum Contaminant Levels (Recycled Water Quality Specifications A.1, A.2, A.3, & A.15)
2-4a 2-4b	Recycled Water Monitoring: Remaining Priority Pollutants, EDCs & Pharmaceuticals, and Unregulated Chemicals (Monitoring & Reporting Program)
2-5	Alternative Monitoring Plans: TOC & TN
2-6	RWC, TOC Average, and TN Compliance Summary
2-7a	Diluent Water Monitoring: Local Runoff / Stormwater
2-7b	Diluent Water Monitoring: State Water Project – Silverwood Lake
2-8	Summary of Wells in Groundwater Monitoring Networks
2-9	Groundwater Monitoring Well Results (Quarterly)
3-1	Diluent & Recycled Water Recharge Volumes
6-1	MVWD ASR Project - TIN/TDS Mass Balance

LIST OF FIGURES

1-1	Basin Locations
2-1	Monitoring Well Network: Hickory and Banana Basins
2-2	Monitoring Well Network: Turner Basins
2-3	Monitoring Well Network: 7th & 8th Street Basins
2-4	Monitoring Well Network: Ely Basins
2-5	Monitoring Well Network: Brooks Street Basin
2-6	Monitoring Well Network: Declez and RP3 Basins
2-7	Monitoring Well Network: San Sevaine & Victoria Basins

1. Introduction

Inland Empire Utilities Agency (IEUA), Chino Basin Watermaster (Watermaster), Chino Basin Water Conservation District, and San Bernardino County Flood Control District are partners in the implementation of the Chino Basin Recycled Water Groundwater Recharge Program. This is part of a comprehensive water supply program to enhance water supply reliability and improve the groundwater quality in local drinking water wells throughout the Chino Basin by increasing the recharge of stormwater, imported water and recycled water. This program is an integral part of Watermaster's Optimum Basin Management Program (OBMP).

A. Order No. R8-2007-0039

On June 29, 2007, the Santa Ana Regional Water Quality Control Board (Regional Board) adopted Order No. R8-2007-0039 (Order) which prescribes the requirements for recycled water use for groundwater recharge in 13 recharge sites within the Chino-North Groundwater Management Zone. The locations of recharge basins in the Chino Basin Groundwater Recharge Program are shown in Figure 1-1.

As a provision of the Order, IEUA and Watermaster must also comply with Monitoring and Reporting Program (MRP) defined in the Order. The MRP includes the water quality monitoring requirements of the Chino Basin Recycled Water Groundwater Recharge Program and the requirement for the submittal of quarterly and annual reports. This document is the quarterly report for the second quarter of 2026 (2Q26).

The quarterly report includes the following elements as prescribed in the MRP:

- Monitoring results for recycled water, diluent water, and groundwater.
- Recycled water and diluent water volumes recharged at each basin.
- Reporting of any non-compliance events due to water quality, including records of any operational problems, plant upset and equipment breakdowns or malfunctions, and any diversion(s) of off-specification recycled water and the location(s) of final disposal. All corrective or preventive action(s) taken.
- Certification that no groundwater has been pumped for domestic water supply use from the buffer zone that extends 500 feet and 6-months underground travel time from the recharge basin(s) where recycled water is applied.

B. Order No. R8-2009-0057

On October 23, 2009, the Regional Board adopted Order No. R8-2009-0057, which amended the Order by revising the averaging period for determining a recharge site's recycled water contribution (RWC) from 60-month to 120-month averaging period. The Order No. R8-2009-0057 also allowed a fraction of the groundwater underflow of the Chino Basin aquifers to be used as a source of diluent water when calculating the running average RWC.

C. Revised Monitoring & Reporting Program No. R8-2007-0039

On October 27, 2010, the Regional Board revised the MRP in the Order based on the requests for modifications from IEUA, which were approved by the State Water Resources Control Board – Division of Drinking Water (DDW, formerly California Department of Public Health). The following changes were made to the MRP:

- 1) Sampling Requirements A.3, A.4, and A.5 were modified by specifying that samples shall be collected on a representative day instead of the 10th day.

- 2) Groundwater Monitoring Program Requirement V.1. was modified by adding a sentence to the paragraph that allows IEUA to analyze the groundwater samples collected on a quarterly basis from non-active municipal drinking water wells for dissolved metals, instead of total recoverable metals.
- 3) Reporting Requirement VI.B.3.b. was modified and footnote No. 18 was added to reflect that IEUA uses groundwater monitoring information contained in the *State of the Basin* report prepared on a biennial basis by Watermaster, amongst other sources, for the annual determination of the recycled water groundwater flow path.

D. Title 22, Division 4, Chapter 3. Article 5.1 §60320.100

On June 18, 2014, the DDW adopted new regulations pertaining to Groundwater Replenishment Reuse Projects (GRRP), which can be found in Title 22 California Code of Regulations, Division 4, Chapter 3. Article 5.1 “Indirect Potable Reuse: Groundwater Replenishment - Surface Application” found in Sections §60320.100 through 60320.130. Pursuant to the new GRRP regulations, additional monitoring and reporting began in 3Q15.

The DDW GRRP regulations require that all GRRPs permitted prior to June 18, 2014 submit a report to the DDW and Regional Board to assess compliance of the existing permit in alignment with the GRRP requirements. The IEUA submitted the Compliance Assessment Report (CAR) for the Chino Basin Recycled Water Groundwater Recharge Project dated June 18, 2015 and a revised CAR dated December 12, 2018. On July 25, 2019, the DDW sent a letter to IEUA with their comments on the CAR. The DDW granted a deadline extension for IEUA to submit responses in an October 21, 2019 email. IEUA responded to the DDW comment letter on November 27, 2019. The DDW and IEUA have collaborated since then to ensure alignment with regulatory requirements.

E. Outline of the Quarterly Report

Section 2 of this quarterly report discusses the water quality monitoring results for recycled water recharge (water recycling plant effluent, distribution system, and basin surface water), diluent water, and groundwater. Section 3 provides an overview of recharge operations including the volume of diluent water and recycled water recharged. Section 4 describes any operational problems and preventive and/or corrective actions taken. Section 5 contains the certification of non-pumping in the 500-foot buffer zones around each basin. Section 6 is a brief overview of the Monte Vista Water District’s (MVWD) Aquifer Storage and Recovery (ASR) project.

2. Monitoring Results

A. Recycled Water: RP-1 and RP-4

The requirements for recycled water monitoring are described in the MRP. Tables 2-1 through 2-4 include all of the requisite 2Q26 data.

Recycled Water Quality Specifications A.5 through A.9 in the Order are the narrative limits established in the permit. The corresponding monitoring data used to determine compliance with the Order are presented in Tables 2-1 and 2-2. The monitoring data in Table 2-1 is collected from samples of RP-1 and RP-4 effluent. The total nitrogen (TN) limit for recycled water is 10 mg/L based on the DDW GRRP regulations (Title 22 §60320.110). The previous TN limit and method of compliance in the Regional Board’s permit (Order R8-2007-0039) for this recharge program was 5 mg/L using alternative monitoring plans with reduction factors. The assessment of compliance using alternative monitoring plans is described in Section 2.B and Table 2-5 and is included as part of the quarterly reporting until there is a new recycled water recharge permit adopted by the Regional Board. During 2Q26, there were no exceedances of the TN limit. Table 2-2 shows the agency-wide monthly and 12-month running average

concentrations for Total Inorganic Nitrogen (TIN) and Total Dissolved Solids (TDS) with effluent limitations of 8 mg/L and 550 mg/L, respectively. The 12-month running average TDS and TIN concentration did not exceed the TDS and TIN limits during 2Q26.

Recycled Water Quality Specifications A.1 through A.4 of the Order are numerical limits based on the Federal and State primary maximum contaminant levels (MCLs), secondary MCLs, and Action Levels. Recycled Water Specification A.15 is a numerical limit for oil and grease.

Table 2-3a shows the results for the DDW approved sample location representative of the recycled water blend from RP-1 and RP-4 used for recharge located at the RP-4 1299 Pressure Zone Pump Station (RW Blend). Table 2-3b shows results for the RP-1 001B effluent. During the CAR review, DDW identified that 001B effluent must be sampled and reported independently of the RW Blend.

In the Order, compliance for all constituents with MCLs or Action Levels is based on a 4-quarter running average (Recycled Water Specifications A.1 through A.4). Table 2-3a (RW Blend) and Table 2-3b (RP-1 001B effluent) summarize the 4-quarter running average concentration for each parameter from 3Q25 through 2Q26 and lists the corresponding compliance limits.

Although the RW Blend sample from the RP-4 1299 Pump Station and 001B Effluent are suitable sample locations for most constituents in recycled water, it is not appropriate for Total Trihalomethanes (TTHMs) and Total Haloacetic Acids (HAA5). Compliance samples for these compounds are taken from lysimeters or monitoring wells at basins actively receiving recycled water. At these locations, the samples better represent the compounds present in the recycled water prior to reaching the groundwater table, as the concentrations of these constituents change through the recharge process. Once a quarter, a representative sample is collected from a selected compliance lysimeter/monitoring well and analyzed for these compounds. For the 2Q26, IEUA chose the DCZ-LYS-25 lysimeter as the compliance point, as it has received many years of recycled water deliveries. Recycled water was present based on electrical conductivity (EC) measurements.

Tables 2-4a (RW Blend) and 2-4b (RP-1 001B Effluent) summarize the quarterly monitoring results of recycled water for constituents with no MCLs or Action Levels; this includes priority pollutants, chemicals of emerging concern (CECs), and chemicals with state notification levels.

Note that in Tables 2-4a and 2-4b there is a section named “Health-based and performance indicator CECs for Surface Application”, which includes CECs listed as monitoring requirements in the State Water Resources Control Board’s (State Water Board) amendment to the Policy for Water Quality Control for Recycled Water (Recycled Water Policy) adopted on December 11, 2018, and effective as of April 8, 2019. The amendment included updates to the CECs monitoring list based on the 2018 Science Advisory Panel recommendations.

There were no exceedances for the parameters analyzed during 2Q26 in the following categories: primary MCLs for per- and poly-fluoroalkyl substances, *with the exception of PFOA*; inorganic chemicals; volatile organic compounds (VOCs); non-volatile synthetic organic chemicals (SOCs); radionuclides; disinfection byproducts; action levels for lead and copper; notification level (NLs) for unregulated chemicals; secondary MCLs for required constituents, *with the exception of odor*; and oil & grease. PFOA and odor exceedances are detailed below.

PFOA

In August 2019, the NL for PFOA was lowered from 14 ng/L to 5.1 ng/L. Prior to August 2019, PFOA concentrations in recycled water never exceeded the initial NL. However, since the NL was lowered during 3Q19, PFOA concentrations in the recycled water have exceeded the NL at both the RW Blend and 001B Effluent sample locations. No confirmation sample was collected within 72 hours of notification of the first results in exceedance, and in accordance with §60320.120(b) weekly sampling began on 10/24/19.


- §60320.120(b)(1) states that “If the running four-week average exceeds the contaminant’s NL, a project sponsor shall describe the reason(s) for the exceedance and provide a schedule for completion of corrective actions in a report submitted to the Regional Board no later than 45 days following the quarter in which the exceedance occurred, with a copy concurrently provided to the Department.” The PFOA four-week average concentrations continued to exceed the NL after accelerated monitoring was implemented and the corrective actions report was submitted to the DDW and the Regional Board on February 13, 2020.
- IEUA completed the sixteen consecutive weeks of sampling the RW Blend and 001B Effluent per §60320.120(b)(2) during 1Q20 and notified the DDW and the Regional Board after the final results were received. Notifications of exceedance were emailed to the Regional Board and DDW on February 25, 2020 for the RW Blend and on March 5, 2020 for the 001B Effluent.
- In a March 5, 2020 email, DDW stated that IEUA needs to continue with weekly samples for PFOA in the recycled water. Weekly sampling was reinitiated during the third week of March 2020.
- In a meeting on January 17, 2024, IEUA provided DDW staff with an update on the PFOA Corrective Actions Report (CAR). An updated CAR with the University of California Irvine (UCI) PFAS Research Project will be submitted when the final report becomes available. The research project is a sewershed-scale analysis of PFAS in wastewater from domestic, commercial, and industrial sewerage system users. Additionally, IEUA’s sewershed monitoring study will be submitted to the DDW once the IEUA study has been completed.

In April 2024, the Environmental Protection Agency (EPA) set new MCLs for PFAS and that became effective June 25, 2024. The DDW is currently in the process of developing California-specific MCLs for PFAS. The federal MCL for PFOA is 4 ng/L.

The tables below show the weekly results and 4-week running average PFOA concentrations in recycled water for 2Q26:

Date	RW Blend (ng/L)	4-week avg (ng/L)	Date	001B Eff (ng/L)	4-week avg (ng/L)
04/01/26	3.7	3.5	04/01/26	2.6	2.7
04/08/26	3.1	3.3	04/08/26	2.3	2.6
04/15/26	3.0	3.2	04/15/26	2.5	2.4
04/22/26	3.1	3.2	04/22/26	2.4	2.4
05/01/26	3.3	3.2	04/29/26	2.7	2.5
05/06/26	3.2	3.2	05/07/26	2.9	2.6
05/13/26	3.0	3.2	05/13/26	3.1	2.9
05/20/26	2.6	3.0	05/20/26	2.1	2.7
05/27/26	2.9	2.9	05/27/26	2.6	2.7
06/03/26	5.3	3.5	06/03/26	3.1	2.7
06/10/26	3.4	3.6	06/10/26	3.3	2.8
06/17/26	3.0	3.7	06/17/26	2.6	2.9
06/24/26	2.7	3.6	06/24/26	2.3	2.8

The chart below shows the trend in PFOA in recycled water from 2019 to 2026. As shown in the chart below, there is a decreasing trend in PFOA concentrations sampled at RW Blend and 001B Effluent approximately starting in April 2021. Despite this decreasing trend, one RW Blend sample collected during 2Q26 exceeded the federal MCL on June 3, 2026, as shown in the table above.

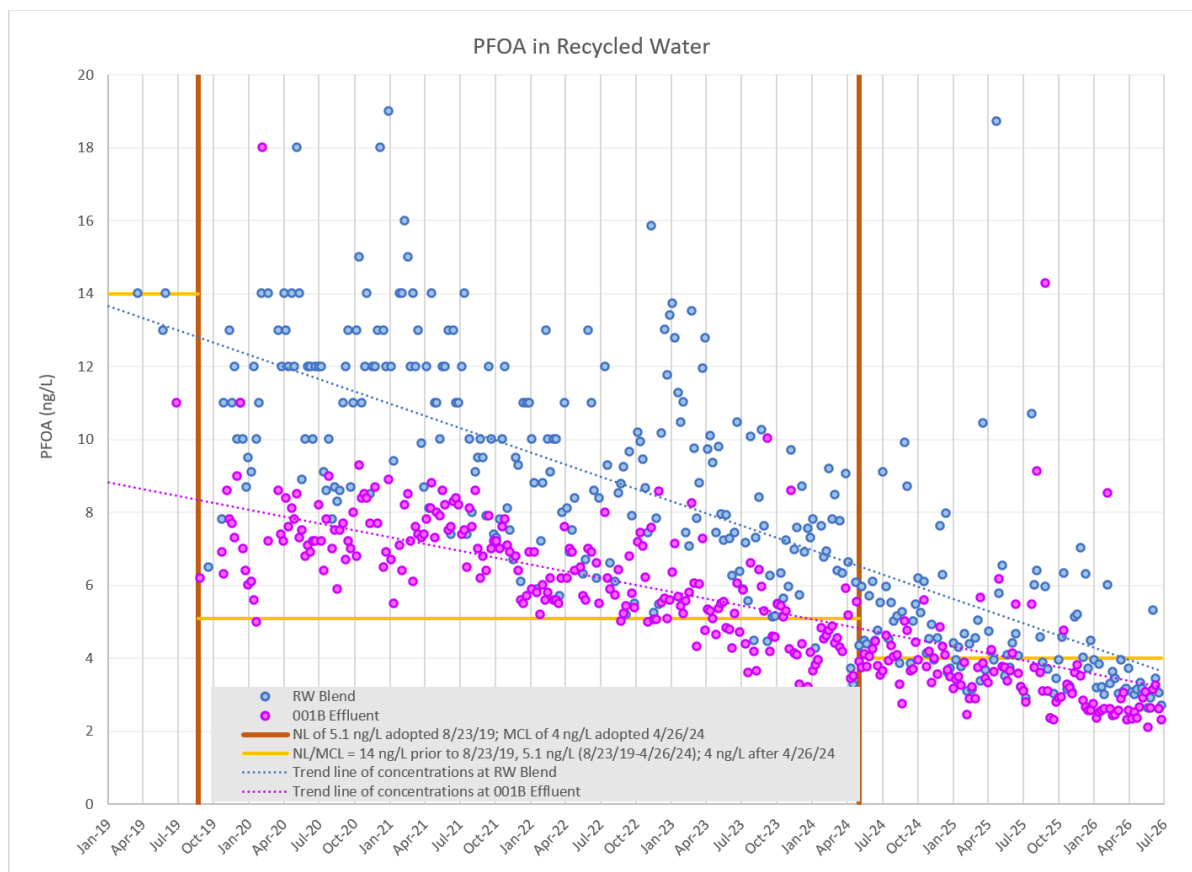

Odor

Odor has a secondary MCL of 3 Threshold Odor Number (TON) in the Recycled Water Specification A.3. The 4-quarter running average (using the four most recent quarterly odor values since odor is an annual monitoring requirement) for 2Q26 were 15 TON and 7 TON at the RW Blend and 001B Effluent, respectively, causing the threshold odor compliance metric to exceed the secondary MCL. Order No. R8-2007-0039 allows compliance for secondary MCLs to be determined at the mound monitoring well. Based on the mound monitoring well data (Table 2-9), threshold odor did not exceed 3 TON at all the nearest downgradient monitoring wells during 2Q26. The 4-quarter running average will remain the same until the next annual sampling is conducted.

B. Recycled Water: Alternative Monitoring Plans for TOC and TN

Total organic carbon (TOC) and nitrogen species sampling and analyses were performed weekly or monthly at lysimeters at some basins when recycled water is being delivered, for the determination of compliance with Recycled Water Specifications A.7 and A.9 of the Order. However, starting 3Q22 all recharge basins have transitioned to alternative monitoring plans to determine compliance with TOC and TN, and lysimeter monitoring is no longer used.

As indicated in Recycled Water Compliance Determination B.5 and B.6 of the Order, alternative monitoring plans to the lysimeter-based compliance sampling for TOC and TN under Recycled Water Specifications A.7 and A.9 can be established upon development of a soil-aquifer treatment factor using recharge demonstration studies. The alternative monitoring plans can be determined in the basin Start-up Period Reports or First Year Operations Reports, and /or subsequent data-based demonstrations for the DDW and the Regional Board. The alternative TOC and TN monitoring plans approved by the Regional

Board and DDW include alternative monitoring locations that include: sampling at a recycled water distribution turnout with the application of a reduction factor.

In June 2015, the DDW issued a letter that approved the request for 50% RWC for most of the basins where recycled water recharge had initiated, with the exception of San Sevaine 5 (no longer being recharged with recycled water but is permitted to recharge recycled water) and Turner Basins. At the time of requesting the 50% RWC for Turner Basins, DDW determined that IEUA did not have enough data to demonstrate arrival of recycled water. This was written in their approval letter. The DDW's justification in the letter for the 50% RWC was: "For most of the recharge basins, the data does show an increasing amount of EC and chloride in the mound monitoring wells over time, indicating that recycled water is reaching the mound. Corresponding TOC data from the mound monitoring wells also show a consistent TOC level of less than 1.0 mg/L when recycled water is present; therefore, increasing the RWC limit to 50 percent for some basins is justified."

In 2Q24 the TOC reduction factors were recalculated for 8th Street, Banana, Brooks, Ely, Hickory, and Victoria Basins due to findings in a 2015 DDW letter that TOC concentrations are less than 1.0 mg/L in concurrence with the presence of recycled water. The reduction factors were recalculated based on the average percent reduction of TOC at the mound monitoring wells for last five years.

The following are the alternative monitoring plans for each basin:

- 7th & 8th Street Basin: Sampling at the RW Blend with a reduction factor of 93 percent for TOC and 75 percent for TN
- Banana Basin: Sampling at the RW Blend with a reduction factor of 93 percent for TOC and 47 percent for TN
- Brooks Basin: Sampling at the RW Blend with a reduction factor of 92 percent for TOC and 83 percent for TN.
- Declez Basin: Sampling at the RW Blend with a reduction factor of 62 percent for TOC and 91 percent for TN
- Ely Basins: Sampling 001B Effluent with a reduction factor of 86 percent for TOC and 52 percent for TN
- Hickory Basin: Sampling at the RW Blend with a reduction factor of 93 percent for TOC and 27 percent for TN
- RP3 Basin: Sampling at the RW Blend with a reduction factor of 88 percent for TOC and 31 percent for TN
- San Sevaine Basin 1-3: Sampling at the RW Blend with a reduction factor of 92 percent for TOC and 34 percent for TN.
- Turner Basins 1 & 2: Sampling at the RW Blend with a reduction factor of 70 percent for TOC and 87 percent for TN
- Turner Basins 3 & 4: Sampling at the RW Blend with a reduction factor of 85 percent for TOC and 87 percent for TN
- Victoria Basin: Sampling at the RW Blend with a reduction factor of 91 percent for TOC and 82 percent for TN

The TOC and TN values calculated based on the alternative monitoring locations and the application of the reduction factors listed above are summarized in Table 2-5. During 2Q26, there were no exceedances of TOC and TN at basins based on the alternative monitoring plans. As part of the CAR review, the DDW clarified that compliance with the TN limit of 10 mg/L cannot be based on the reduction factor previously

established for the alternative monitoring. Instead, the DDW clarified that the TN limit from the GRRP regulations must be met at the recycled water distribution turnouts. As shown in Table 2-1, there was no exceedance of TN limit at 001B Effluent or RP-4 Effluent. The recycled water monitoring has met the TN compliance for 2Q26 as demonstrated in Table 2-1. However, alternative monitoring using the reduction factor will continue to be reported for the Regional Board until a new GWR permit is issued.

During 4Q24, IEUA submitted a request to increase the RWC to 50% and to revise the TOC compliance locations for the Declez and Turner Basins. In response to IEUA's request, the DDW requested the 20-week running average TOC data for the previous 52 weeks and asked that it be compared to the applicable TOC_{avg} limit (0.5 mg/L divided by the proposed maximum RWC). The request remains pending as additional data is being collected to address DDW's request.

Table 2-6 is a compliance summary table for RWC, TOC average, and TN compliance. It includes the following: when the basin started receiving recycled water; when the startup period was completed; the RWC limit; the current RWC; the current TOC average limit (based on Recycled Water Specification A.10); compliance with the calculated TOC average limit based on maximum TOC average on a 20-week average and a 4-sample average; compliance with the TN limit, and recharged water monitoring plans for TOC and TN.

C. Diluent Water

In addition to recycled water recharge, the two other recharge water sources are imported water and stormwater / local runoff; these two types of water are considered diluent water. Imported water and stormwater / local runoff must be sampled quarterly in accordance with the DDW-approved Diluent Water Monitoring Plan.

Details on the methods used to measure daily diluent water flow and diluent water monitoring schedule can be found in the Diluent Water Monitoring Plan. The quarterly sampling schedule for stormwater and local runoff is presented in Table 4-2 of the plan. Stormwater is sampled during the rainy season (typically in the 1st and 4th quarters) and local runoff is sampled during the dry season (typically in the 2nd and 3rd quarters). Samples are collected at about half the locations during each seasonal quarter, alternating between even and odd years. Table 5-1 of the plan summarizes the sample type and reporting frequency for the parameters listed in Tables I, II, III, and IV of the Diluent Water Monitoring requirement III.3 of the MRP. For 2Q26, diluent water quality sampling of one local runoff site were conducted. Table 2-7a lists the results of diluent water sampling and analyses for 2Q26. The maximum level to trigger a source water evaluation exceeded primary MCLs for PFOA and PFOS during the 2Q26 monitoring.

As part of the CAR, IEUA prepared a preliminary evaluation of potential source for all the contaminants where concentrations exceeded the maximum level to trigger a source evaluation in previous quarters. The CAR was submitted to and is pending review and comment by the DDW. These contaminants are as follows: aluminum, arsenic, bromate, chlorite, di(2-ethylhexyl)phthalate, dichloromethane, HAA5, heptachlor, lead, NO_3-N , and perchlorate. Additional contaminants may need to be added to a future evaluation prior to issuance of a new GWR permit.

Table 2-7b lists the results from Metropolitan Water District's (MWD) general mineral and physical analysis of water from Silverwood Lake, the source of imported water for recharge.

D. Groundwater Monitoring Wells

Monitoring is conducted at groundwater monitoring wells quarterly and annually to evaluate groundwater quality conditions in the vicinity of the recharge basins utilizing recycled water. Groundwater monitoring results can be used to assess background conditions, time the arrival of recharge waters, and assess the impact that recharged water has on downgradient water supplies. The wells in the monitoring networks for Hickory and Banana, Turner, Declez, RP3, 7th & 8th Street, Brooks Street, San Sevaire, Victoria, and

Ely Basins are summarized in Table 2-8, and presented on Figures 2-1 through 2-7, respectively. Groundwater quality samples are collected and tested quarterly for all constituents listed in Table 1 of Section V in the MRP R8-2007-0039, and annually for constituents specified in the Phase II Findings of Fact, Attachment A in the permit (Bullet 27 in the Conditions Section). The groundwater constituents analyzed from the monitoring wells during quarterly monitoring are presented in Table 2-9.

“Samples with concentrations that exceeded the primary or secondary MCLs are highlighted in magenta and yellow, respectively, in Table 2-9. The DDW is notified within 48 hours of receiving results with concentrations that exceed the primary MCLs or with the presence of coliform at active municipal wells. There is no requirement to report exceedances of primary MCLs or the presence of coliform at non-municipal wells (e.g., monitoring, industrial, etc.) to the DDW within 48 hours. Instead, these exceedances and presence of coliform at non-municipal wells are reported in the quarterly report.

There was no exceedance of primary MCLs or presence of coliform at municipal wells in 2Q26. The following provides a summary of exceedances of primary and secondary MCLs at non-municipal wells in 2Q26:

Primary MCL Exceedance

- NO₃-N was detected above the primary MCL of 10 mg/L at Alcoa MW3, Southridge JHS, BRK-1/2, BRK-2/2, Ely Basin MW2 Walnut Street, and Bishop of SB Corp. - DOM. The NO₃-N concentrations at these wells range from 10.4 to 26.5 mg/L and are characteristic of groundwater quality in these areas of the Chino Basin. The distribution of NO₃-N concentrations observed at wells in the Chino Basin is summarized in Watermaster’s State of the Basin Reports. No notifications were made to the DDW as these high NO₃-N concentrations are comparable to the ambient NO₃-N concentration in groundwater for each monitoring well’s respective groundwater management zone within the Chino Basin.

Secondary MCL Exceedances

- TDS was detected above the secondary MCL of 500 mg/L at Alcoa MW3, Southridge JHS, and Ely Basin MW2 Walnut Street, and Bishop of SB Corp. - DOM. TDS concentrations during 2Q26 at these wells range from 542 to 672 mg/L and are characteristic of groundwater TDS concentration at these areas of the Chino Basin. The distribution of TDS concentrations observed at wells in the Chino Basin is summarized in Watermaster's State of the Basin Reports.
- EC was detected above the secondary MCL of 900 µmhos/cm at Southridge JHS and Ely Basin MW2 Walnut Street. These exceedances correlate with the exceedances of secondary MCL for TDS at the same wells.
- Color was detected above the secondary MCL of 15 units at 8TH-1/1.
- Turbidity was detected above the secondary MCL of 5 NTU at 8TH-1/1, 8TH-1/2, 8TH-2/2, and SSV-2. Turbidity concentrations during 2Q26 at these wells ranged from 13.3 to 31.0 NTU.

The 2024 State of the Basin can be reviewed and accessed at the Watermaster’s website, www.cbwm.org.

The 2014 GRRP regulations require two downgradient monitoring wells to be monitored annually for Priority Toxic Pollutants, and that the wells are located (A) no less than two weeks but no more than six months of travel through the unsaturated zone affected by the project, and (B) at least 30 days upgradient of the nearest drinking water well. *The next annual monitoring will take place in 4Q26.* The table below shows the monitoring wells that meet the (A) and (B) criteria specified above.

Basins	Monitoring Well (A)	Monitoring Well (B)
7 th & 8 th Street	8TH-1/2	8TH-2/1
Banana & Hickory	BH-1/2	BH-2/1

Basins	Monitoring Well (A)	Monitoring Well (B)
Brooks	BRK-1/1	BRK-2/1
Ely	ELY-3	Ely MW2
RP3	RP3-1/1	Southridge JHS
Turner	T-1/2	T-2/2
Victoria & San Sevaine	SSV-2 & VCT-1/1	VCT-2/2
Declez	DCZ-1/1	DCZ-2

3. Recharge Operations

IEUA's GWR staff records the daily volumes of water routed to the recharge basins. The 7th & 8th St, Brooks, Ely, Declez, RP3, San Sevaine, and Victoria Basins received recycled water this quarter. Table 3-1 lists the volumes of recycled water and diluent water (imported water and/or local runoff/storm flow) captured during the most recent four quarters at the basins that have initiated recharge using recycled water.

4. Operational Problems & Preventive or Corrective Actions

No operational problems were encountered this quarter; therefore, no corrective actions were necessary for the following: Regional Water Recycling Facilities - RP-1 & RP-4 and recharge operations.

Although IEUA did not encounter operational problems in 2Q26, IEUA encountered issues that prevented monitoring at specific wells during the quarter. The following summarizes the issues:

- Pomona Well 34, California Speedway – Infield Well, Ontario Well No. 38, and Ontario Well No. 29 had pump motor issues that were not resolved this quarter.
- California Speedway 2 well was abandoned during 2Q26.
- DCZ-1/1 is undergoing well rehabilitation to correct turbidity issues.

5. Certification of Non-Pumping in the Buffer Zones

Watermaster has certified that there was no reported pumping of groundwater in 1Q26 for domestic or municipal use from the buffer zones that extend 500 feet and 6 months underground travel time from the 7th & 8th St, Banana, Brooks, Declez, Ely, Hickory, RP3, San Sevaine, Turner, Victoria Basins. In fact, there are no domestic or municipal production wells within the buffer zones of these aforementioned recharge sites.

IEUA continues to work with the San Bernardino County Department of Environmental Health Services (SBCDEHS) to prevent the drilling and construction of new drinking water wells within the buffer zones. SBCDEHS has initiated control over production well permitting within the buffer zones of all recharge sites through the use of buffer zone maps that utilize the same land coordinate system (Township/ Range/ Section/ 40-acre Parcel) that is used in the permitting process. SBCDEHS reviews new well permit applications, in part, by checking the proposed location of a new drinking water well against recharge basin location maps and parcel lists, both provided by IEUA. The maps and lists show township/range/section parcels (40-acre parcels) that abut recharge basins and their 500-foot buffers.

If a proposed well falls within an abutting parcel, SBCDEHS will review the well location using maps of the basins and buffer zones. If the well falls too near the buffer zone boundary for SBCDEHS to determine the relationship of the proposed well location to the buffer boundary, SBCDEHS will defer to IEUA for a prompt field review of the proposed well location. The field review may include contacting and having the well applicant identify the exact location of the proposed well casing. To conduct a detailed field

review, SBCDEHS will contact and provide the IEUA Groundwater Recharge Coordinator with a copy of the well permit application and a timeline for the completion of IEUA's review. Following the review, IEUA will notify SBCDEHS of its findings in writing. IEUA will also notify the DDW and the Regional Board of well permit applications that it recommends should be declined due to well locations determined to fall within a 500-foot buffer zone.

6. MVWD ASR Project

Reporting for the Monte Vista Water District (MVWD) Aquifer Storage and Recovery (ASR) project was allowed by the Regional Board to be included under IEUA/Watermaster Phase I Groundwater Recharge Order No. R8-2005-0033 and subsequent permit updates. In April 2007, MVWD, Watermaster, and IEUA entered into an agreement to report the MVWD ASR project groundwater injection/recovery volumes and TIN/TDS mass balance in the recharge program quarterly reports. Initial injection began in June 2007. Injection activities have been periodic since the program began in 2007. There was no injection activity during 2Q26. Table 6-1 summarizes the monthly volumes and TIN/TDS of injected and recovered water for the last year (3Q25 to 2Q26) and the mass balance of TIN/TDS from the injection-recovery cycles.

7. Exceedance Summary Table

The table below summarizes the recycled water, diluent water, and monitoring well exceedances from 2Q26.

Sample Type	Site	Exceedance
RW	RW Blend	Primary MCL (4.0 ng/L) – PFOA (single sample) Secondary MCL (3 TON) – Odor (this will remain until next annual sampling)
RW	001B Effluent	Secondary MCL (3 TON) – Odor (this will remain until next annual sampling)
Diluent – Local Runoff	West Cucamonga Creek @ Ely Basin	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	Alcoa MW3	Primary MCL (10 mg/L) – Nitrate as N Secondary MCL (500 mg/L) - TDS
Well	Southridge JHS	Primary MCL (10 mg/L) – Nitrate as N Secondary MCL (200 µmhos/cm) – EC Secondary MCL (500 mg/L) – TDS
Well	8TH-1/1	Secondary MCL (15 units) – Color Secondary MCL (5 NTU) – Turbidity
Well	8TH-1/2	Secondary MCL (5 NTU) – Turbidity
Well	8TH-2/2	Secondary MCL (5 NTU) – Turbidity
Well	Bishop of SB Corp. – DOM	Primary MCL (10 mg/L) – Nitrate as N Secondary MCL (500 mg/L) - TDS
Well	BRK-1/2	Primary MCL (10 mg/L) – Nitrate as N
Well	BRK-2/2	Primary MCL (10 mg/L) – Nitrate as N
Well	Ely Basin MW2 Walnut St.	Primary MCL (10 mg/L) – Nitrate as N Secondary MCL (200 µmhos/cm) – EC Secondary MCL (500 mg/L) - TDS

Sample Type	Site	Exceedance
Well	RP3-1/1	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	SSV-2	Secondary MCL (5 NTU) – Turbidity

Table 2-1a
Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for April 2025
(Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
Limits	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
	2.5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2.5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
04/01/25	0.5	7.8				6.9	746			<1	0.7	7.0				7.1	645			<1
04/02/25	0.5	7.6	5.2	6.4	5.2	6.9	734			<1	0.6	6.6	6.6		6.7	7.1	646			<1
04/03/25	0.5	7.1				6.9	743			<1	0.6	6.4				7.0	645			<1
04/04/25	0.5	7.0				6.9	739			7	0.6	6.5				7.0	636			<1
04/05/25	0.6	7.2				6.9	753			<1	0.6	6.7				7.0	630			<1
04/06/25	0.6	6.9	5.4	6.4	5.4	6.9	760	446		<1	0.7	6.4	4.6	5.0	4.6	7.1	632	420		<1
04/07/25	0.5	7.5				6.9	731			<1	0.6	7.1				7.0	635			1
04/08/25	0.6	7.4				6.9	717			<1	0.7	7.1				7.0	640		148	<1
04/09/25	0.6	7.2	4.2	5.0	4.2	6.9	689			1	0.7	6.6	4.7		4.7	7.0	638			<1
04/10/25	0.7	6.9				6.9	687			<1	0.7	6.8				7.0	637			<1
04/11/25	0.7	6.9				7.0	725			<1	0.8	6.6				7.0	638			<1
04/12/25	0.7	7.1				7.0	710			<1	0.8	6.7				7.0	639			<1
04/13/25	0.7	7.0	4.8	5.6	4.8	7.0	705	466		<1	0.8	6.4	3.8	4.6	3.9	7.1	644	450		<1
04/14/25	0.7	7.0				7.0	700			<1	0.8	6.7				7.1	642			<1
04/15/25	0.7	7.7				6.9	725		162	1	0.6	6.7				7.1	640			1
04/16/25	0.7	7.2	4.3	5.3	4.3	6.9	703			<1	0.5	6.5	5.3		5.4	7.0	652			1
04/17/25	0.7	6.8				6.9	705			<1	0.5	6.2				7.1	654			<1
04/18/25	0.7	6.7				6.9	720			<1	0.5	6.2				7.1	648			<1
04/19/25	0.6	6.9				6.9	733			<1	0.5	6.1				7.1	644			<1
04/20/25	0.6	7.0	4.4	5.5	4.5	6.9	728	478		1	0.5	6.3	3.4	4.3	3.4	7.1	638	426		<1
04/21/25	0.6	7.1				6.9	700			<1	0.5	6.4				7.0	755			<1
04/22/25	0.7	7.5				6.9	656			17	0.6	6.6				7.0	888			<1
04/23/25	0.6	7.2	4.5	5.2	4.5	6.9	598			1	0.6	6.4	4.4		4.4	7.0	891			<1
04/24/25	0.6	7.0				6.9	590			15	0.6	6.2				7.0	897			<1
04/25/25	0.7	6.7				6.9	623			<1	0.6	5.9				7.0	893			<1
04/26/25	0.7	7.1				6.8	606			<1	0.6	6.2				7.0	891			<1
04/27/25	0.7	6.6	4.9	5.7	4.9	6.9	600	452		<1	0.6	6.1	4.6	5.3	4.6	7.0	893	444		<1
04/28/25	0.7	7.1				6.8	602			<1	0.7	6.1				7.0	815			<1
04/29/25	0.7	7.4				6.8	637			3	0.7	6.6				7.1	747			<1
04/30/25	0.7	7.0	4.2	5.1	4.2	6.9	659			<1	0.7	6.3	4.4		4.4	7.1	774			<1
Avg	0.6	7.1	4.6	5.6	4.7	6.9	691	461	162	<2	0.6	6.5	4.6	4.8	4.7	7.0	709	435	148	<1
Min	0.5	6.6	4.2	5.0	4.2	6.8	590	446	162	<1	0.5	5.9	3.4	4.3	3.4	7.0	630	420	148	<1
Max	0.7	7.8	5.4	6.4	5.4	7.0	760	478	162	17	0.8	7.1	6.6	5.3	6.7	7.1	897	450	148	1

Note: **Bolded characters signify an exceedance of a permit limitation** 420 Revised 6/10/26. Regional Board noticed TDS data did not match NPDES report. Links to the NPDES report were updated.

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-1b
Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for May 2025
(Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
Limits	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
05/01/25	0.7	6.9				6.8	666			<1	0.7	6.7				7.1	757			<1
05/02/25	0.7	7.1				6.8	674			<1	0.7	6.3				7.1	750			<1
05/03/25	0.7	7.3				6.9	681			<1	0.7	6.2				7.1	749			<1
05/04/25	0.7	6.8	5.1	6.0	5.1	6.8	663	446	144	<1	0.7	6.3	4.3	4.8	4.3	7.1	758	424	157	<1
05/05/25	0.7	7.6				6.8	644			<1	0.7	6.3				7.0	744			1
05/06/25	0.7	7.2				6.8	673			<1	0.6	6.3				6.9	738			<1
05/07/25	0.7	7.7	4.4	5.4	4.4	6.8	749			<1	0.6	6.5	4.9		4.9	6.9	739			<1
05/08/25	0.7	7.4				6.8	721			<1	0.6	6.0				6.9	734			<1
05/09/25	0.7	7.1				6.8	751			1	0.6	6.2				6.9	729			<1
05/10/25	0.7	7.9				6.8	755			1	0.6	6.4				6.9	732			<1
05/11/25	0.8	7.7	4.7	5.7	4.7	6.9	739	452		<1	0.6	6.2	3.8	4.6	3.8	6.9	739	444		<1
05/12/25	0.8	5.4	3.3		4.4	6.9	722	485		<1	0.6	6.4				7.0	748			<1
05/13/25	1.0	5.7	2.2		3.3	7.0	773	360		1	0.6	6.3				7.0	751			<1
05/14/25	0.9	7.6	4.4	5.5	4.4	7.0	821			<1	0.6	5.9	5.3		5.3	7.0	759			<1
05/15/25	0.9	7.7				7.1	809			1	0.6	5.8				6.9	756			<1
05/16/25	0.8	6.8				7.1	786			<1	0.6	5.8				6.9	757			<1
05/17/25	0.7	7.6				7.0	812			<1	0.6	6.1				7.0	762			<1
05/18/25	0.6	6.9	5.6	6.2	5.6	7.0	814	438		12	0.6	5.9	4.9	5.7	4.9	7.0	767	434		<1
05/19/25	0.5	7.4				7.0	788			<1	0.6	6.2				6.9	757			<1
05/20/25	0.5	7.3				7.0	772			<1	0.5	6.4				6.9	749			<1
05/21/25	0.5	7.0	4.9	5.8	4.9	7.0	752			<1	0.5	6.1	5.1		5.1	6.9	750			<1
05/22/25	0.5	6.8				7.0	767			1	0.5	5.9				6.9	751			<1
05/23/25	0.5	6.6				7.1	799			<1	0.5	5.3				6.9	753			<1
05/24/25	0.5	6.5				7.1	786			<1	0.5	5.7				7.0	752			<1
05/25/25	0.5	6.6				7.1	782			<1	0.5	5.9				7.0	755			<1
05/26/25	0.5	6.7	5.7	6.3	5.7	7.0	767			<1	0.5	6.0				7.0	756			<1
05/27/25	0.5	6.3				7.0	786			<1	0.5	6.2				7.0	710			<1
05/28/25	0.5	7.1	4.6		4.6	7.0	807	450		<1	0.6	6.2	5.1	5.7	5.1	7.1	675	446		<1
05/29/25	0.5	6.3	4.9	5.7	5.0	6.9	773			<1	0.6	6.0				7.1	675			<1
05/30/25	0.5	6.6				6.9	755			<1	0.7	6.1				7.1	672			<1
05/31/25	0.5	6.5				7.0	731			<1	0.8	6.2				7.1	671			<1
Avg	0.6	7.0	4.5	5.8	4.7	6.9	752	438	144	<1	0.6	6.1	4.8	5.2	4.8	7.0	739	437	157	<1
Min	0.5	5.4	2.2	5.4	3.3	6.8	644	360	144	<1	0.5	5.3	3.8	4.6	3.8	6.9	671	424	157	<1
Max	1.0	7.9	5.7	6.3	5.7	7.1	821	485	144	12	0.8	6.7	5.3	5.7	5.3	7.1	767	446	157	1

Note: **Bolded characters signify an exceedance of a permit limitation** [redacted] Revised 6/10/26. Regional Board noticed TDS data did not match NPDES report. Links to the NPDES report were updated.

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-1c
Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for June 2025
(Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
Limits	2.5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2.5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
06/01/25	0.5	6.0	5.2	5.7	5.3	7.0	730	450		1	0.7	6.2	4.6	5.3	4.7	7.1	667	434		1
06/02/25	0.5	7.1				7.0	775			2	0.7	6.4				7.1	702			<1
06/03/25	0.5	6.5				7.0	801			<1	0.7	6.0				7.1	744			<1
06/04/25	0.5	6.6	5.1	6.0	5.2	7.0	766			<1	0.7	5.9	5.4		5.5	7.1	749			<1
06/05/25	0.5	6.4				7.0	744			<1	0.6	6.0				7.1	747			<1
06/06/25	0.5	6.4				7.0	815			<1	0.6	5.9				7.1	749			<1
06/07/25	0.6	6.6				7.0	778			<1	0.6	6.0				7.1	753			<1
06/08/25	0.6	6.4	5.6	6.6	5.7	7.0	769	472	158	<1	0.6	6.0	5.2	5.3	5.2	7.1	757	436	162	<1
06/09/25	0.5	6.5				7.0	790			<1	0.7	6.1				7.2	754			<1
06/10/25	0.5	7.1				6.9	801			<1	0.7	5.9				7.4	754			<1
06/11/25	0.5	7.0	4.2	4.8	4.3	7.0	772			<1	0.7	5.9	5.6		5.6	7.4	751			<1
06/12/25	0.5	6.8				7.0	768			<1	0.7	5.8				7.4	744			<1
06/13/25	0.5	6.7				7.0	769			<1	0.7	5.7				7.4	742			<1
06/14/25	0.6	7.0				7.0	797			1	0.7	5.8				7.3	743			<1
06/15/25	0.6	7.0	4.8	5.8	4.8	7.0	780	460		<1	0.7	6.0	5.2	5.3	5.2	7.3	749	442		<1
06/16/25	0.7	7.1				7.0	799			1	0.7	6.0				7.3	742			<1
06/17/25	0.7	7.1				7.0	862			<1	0.7	6.0				7.4	752			<1
06/18/25	0.7	7.1	4.8	6.2	4.9	7.1	882			<1	0.7	6.2				7.4	752			<1
06/19/25	0.6	6.8				7.1	862			1	0.6	6.1				7.4	755			<1
06/20/25	0.6	6.9				7.1	836			1	0.7	6.4				7.3	755			<1
06/21/25	0.7	7.3				7.1	828			<1	0.6	6.5				7.3	765			<1
06/22/25	0.6	6.7	5.7	6.1	5.7	7.1	786	438		<1	0.6	6.6	7.0	7.7	7.0	7.3	772	446		<1
06/23/25	0.6	6.8				7.1	818			<1	0.7	6.9				7.3	766			<1
06/24/25	0.6	6.9				6.9	804			1	0.7	6.5				7.3	764			<1
06/25/25	0.6	6.8	5.0	5.7	5.0	7.0	774			1	0.7	6.5	7.6		7.6	7.3	763			<1
06/26/25	0.7	6.7				7.0	786			<1	0.7	6.4				7.3	753			<1
06/27/25	0.7	6.6				7.0	807			<1	0.8	6.5				7.3	744			<1
06/28/25	0.7	6.8				6.9	803			<1	0.9	6.8				7.3	748			<1
06/29/25	0.6	6.4	5.7	6.2	5.7	7.0	782	428		<1	1.0	6.7	6.3	6.7	6.3	7.3	749	422		<1
06/30/25	0.6	6.5				7.0	782			<1	1.0	6.7				7.2	750			<1
Avg	0.6	6.8	5.1	5.9	5.2	7.0	795	450	158	<1	0.7	6.2	5.9	6.1	5.9	7.3	748	436	162	<1
Min	0.5	6.0	4.2	4.8	4.3	6.9	730	428	158	<1	0.6	5.7	4.6	5.3	4.7	7.1	667	422	162	<1
Max	0.7	7.3	5.7	6.6	5.7	7.1	882	472	158	2	1.0	6.9	7.6	7.7	7.6	7.4	772	446	162	1

Note: **Bolded characters signify an exceedance of a permit limitation** Revised 6/10/26. Regional Board noticed TDS data did not match NPDES report. Links to the NPDES report were updated.

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-1a
Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for April 2026

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
Limits	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
04/01/26	0.6	6.5	4.6	5.5	4.7	6.9	632			<1	0.6	5.6	1.4		1.4	7.3	724			<1
04/02/26	0.6	6.4				7.0	611			1	0.6	5.5				7.3	723			<1
04/03/26	0.6	6.5				6.9	605			<1	0.6	5.5				7.3	734			<1
04/04/26	0.6	6.4				6.8	622			<1	0.5	5.5				7.3	733			<1
04/05/26	0.6	6.5	5.0	6.3	5.0	6.9	616	432	156	<1	0.5	5.6	2.3	3.2	2.3	7.3	733	422	141	<1
04/06/26	0.6	6.7				6.9	614			<1	0.5	5.8				7.3	727			1
04/07/26	0.6	6.8				6.8	638			<1	0.5	5.8				7.3	739			<1
04/08/26	0.6	6.8	5.1	6.1	5.1	6.8	627			<1	0.5	5.8	2.9		2.9	7.2	742			<1
04/09/26	0.6	6.3				6.9	579			<1	0.6	5.5				7.2	734			<1
04/10/26	0.6	6.7				6.9	605			1	0.5	5.8				7.3	734			<1
04/11/26	0.7	6.9				7.0	620			<1	0.6	5.7				7.3	726			<1
04/12/26	0.7	6.7	4.8	6.4	4.8	6.9	605	442		<1	0.6	5.8	2.3	4.4	2.3	7.3	733	422		<1
04/13/26	0.7	6.6				6.9	610			<1	0.6	5.8				7.3	733			<1
04/14/26	0.7	6.8				6.8	558			<1	0.6	5.8				7.3	738			<1
04/15/26	0.7	6.4	4.7	5.6	4.7	6.8	558			<1	0.6	5.6	3.4		3.4	7.2	733			<1
04/16/26	0.6	6.4				6.8	580			<1	0.6	5.6				7.2	732			<1
04/17/26	0.6	6.4				6.7	585			2	0.6	5.5				7.2	733			<1
04/18/26	0.6	6.6				6.6	584			<1	0.6	5.6				7.2	736			<1
04/19/26	0.6	6.6	5.5	6.9	5.6	6.7	580	432		1	0.6	5.6	2.2	3.7	2.2	7.2	740	412		<1
04/20/26	0.6	6.8				6.7	572			<1	0.6	5.8				7.3	742			<1
04/21/26	0.6	6.7				6.8	613			<1	0.6	5.8				7.3	743			<1
04/22/26	0.7	6.6	5.4	6.8	5.4	6.9	650			<1	0.7	5.7	3.0		3.0	7.3	741			<1
04/23/26	0.8	6.4				6.8	667			<1	0.7	5.8				7.2	742			<1
04/24/26	0.6	6.4				6.9	683			<1	0.8	5.7				7.2	733			<1
04/25/26	0.6	6.6				6.8	651			<1	0.8	5.8				7.3	739			<1
04/26/26	0.5	6.6	6.2	7.4	6.2	6.9	626	422		1	0.8	5.9	3.0	4.4	3.1	7.3	743	390		<1
04/27/26	0.5	6.8				6.8	616			<1	0.8	6.0				7.3	751			<1
04/28/26	0.5	6.8				6.8	574			<1	0.8	6.0				7.2	778			<1
04/29/26	0.5	6.5	6.1	7.2	6.1	6.9	531			<1	0.8	5.9	3.1		3.1	7.2	771			<1
04/30/26	0.5	6.3				6.9	541			<1	0.8	5.9				7.2	770			<1
Avg	0.6	6.6	5.3	6.5	5.3	6.8	605	432	156	<1	0.6	5.7	2.6	3.9	2.6	7.3	739	412	141	<1
Min	0.5	6.3	4.6	5.5	4.7	6.6	531	422	156	<1	0.5	5.5	1.4	3.2	1.4	7.2	723	390	141	<1
Max	0.8	6.9	6.2	7.4	6.2	7.0	683	442	156	2	0.8	6.0	3.4	4.4	3.4	7.3	778	422	141	1

Note:

Bolded characters signify an exceedance of a permit limitation

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-1b
Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for May 2026

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
Limits	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
05/01/26	0.5	6.4				6.9	522			1	0.8	5.8				7.2	775			<1
05/02/26	0.5	6.3				6.9	505			<1	0.8	5.9				7.2	777			<1
05/03/26	0.5	6.2	6.0	6.5	6.1	7.0	488	402	153	<1	0.7	5.9	2.1	3.0	2.1	7.3	779	380	163	<1
05/04/26	0.5	6.5				7.0	529			<1	0.7	6.1				7.2	784			<1
05/05/26	0.5	6.6				6.6	556			<1	0.7	6.0				7.2	784			<1
05/06/26	0.5	6.7	6.4	7.2	6.5	6.6	548			<1	0.7	5.9	3.3		3.3	7.2	785			<1
05/07/26	0.5	6.4				6.8	617			<1	0.8	5.8				7.2	776			<1
05/08/26	0.5	6.4				6.7	605			<1	0.7	6.0				7.2	772			<1
05/09/26	0.5	6.4				6.7	569			<1	0.8	5.8				7.2	767			<1
05/10/26	0.5	6.4	6.0	7.1	6.0	6.8	545	402		10	0.8	5.9	2.1	3.1	2.2	7.2	768	440		<1
05/11/26	0.5	6.4				6.5	583			<1	0.8	5.9				7.2	762			1
05/12/26	0.5	6.5				6.9	660			1	0.7	6.0				7.2	765			<1
05/13/26	0.5	6.6	6.2	6.9	6.2	7.0	723			<1	0.7	5.8	2.5		2.6	7.2	765			<1
05/14/26	0.5	6.3				6.9	629			<1	0.7	5.8				7.2	762			<1
05/15/26	0.5	6.1				7.0	616			<1	0.7	5.7				7.2	761			<1
05/16/26	0.5	6.1				7.2	648			1	0.8	5.8				7.2	765			<1
05/17/26	0.5	6.1	6.1	6.6	6.1	7.2	648	414		<1	0.8	5.7	2.3	3.4	2.3	7.2	774	420		<1
05/18/26	0.5	6.4				6.9	614			<1	0.8	5.9				7.2	772			<1
05/19/26	0.5	6.3				6.7	629			<1	0.8	5.9				7.2	775			<1
05/20/26	0.5	6.1	5.4	5.9	5.3	6.8	621			<1	0.7	5.6	2.2		2.2	7.2	770			<1
05/21/26	0.5	5.9				6.9	589			<1	0.7	5.5				7.2	767			<1
05/22/26	0.6	5.8				7.0	586			<1	0.6	5.4				7.2	766			<1
05/23/26	0.5	5.7				7.0	580			<1	0.6	5.4				7.2	763			1
05/24/26	0.5	5.6	6.0	7.1	6.1	7.0	559	426		<1	0.6	5.5	2.3	3.3		7.2	765	404		<1
05/25/26	0.4	5.7				7.0	560			<1	0.6	5.6				7.2	769			<1
05/26/26	0.4	6.0				7.0	566			<1	0.7	5.8				7.3	778			<1
05/27/26	0.5	6.1	5.4	6.3	5.5	7.0	597			<1	0.7	5.7	2.6		2.6	7.3	780			<1
05/28/26	0.5	5.5				7.1	606			<1	0.7	5.5				7.3	778			<1
05/29/26	0.5	5.5				7.1	635			1	0.7	5.5				7.2	770			<1
05/30/26	0.6	5.6				7.1	654			<1	0.7	5.4				7.2	769			<1
05/31/26	0.6	5.7	5.8	6.6	5.8	7.1	621	432		<1	0.6	5.6	2.2	3.7	2.2	7.2	768	414		<1
Avg	0.5	6.1	5.9	6.7	5.9	6.9	594	415	153	<1	0.7	5.7	2.4	3.3	2.4	7.2	771	412	163	<1
Min	0.4	5.5	5.4	5.9	5.3	6.5	488	402	153	<1	0.6	5.4	2.1	3.0	2.1	7.2	761	380	163	<1
Max	0.6	6.7	6.4	7.2	6.5	7.2	723	432	153	10	0.8	6.1	3.3	3.7	3.3	7.3	785	440	163	1

Note:

Bolded characters signify an exceedance of a permit limitation

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-1c
Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for June 2026

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
Limits	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
06/01/26	0.6	5.9				7.1	615			<1	0.7	5.9				7.2	764			<1
06/02/26	0.6	6.0				7.1	625			<1	0.6	6.0				7.2	765			<1
06/03/26	0.6	6.0	4.7	5.5	4.8	7.1	634			<1	0.6	6.0	4.7	5.5	4.8	7.2	763			<1
06/04/26	0.6	5.7				7.1	675			<1	0.6	5.7				7.2	769			<1
06/05/26	0.6	5.8				7.1	693			<1	0.6	5.8				7.2	772			<1
06/06/26	0.6	5.9				7.1	695			3	0.6	5.9				7.2	773			<1
06/07/26	0.5	5.5	5.7	6.5	5.7	7.0	707	440	154	<1	0.5	5.5	5.7	6.5	5.7	7.2	775	440	161	<1
06/08/26	0.5	5.9				7.0	695			1	0.5	5.9				7.2	770			1
06/09/26	0.6	6.0				7.0	652			2	0.5	6.0				7.2	782			<1
06/10/26	0.5	5.9	5.8	6.4	5.8	7.0	607			1	0.4	5.9	5.8	6.4	5.8	7.2	780			<1
06/11/26	0.5	5.7				7.1	630			<1	0.4	5.7				7.2	776			<1
06/12/26	0.5	5.6				7.1	619			<1	0.4	5.6				7.2	773			<1
06/13/26	0.6	5.6				7.1	599			1	0.4	5.6				7.2	772			<1
06/14/26	0.6	5.7	6.0	6.8	6.1	7.1	627	444		1	0.5	5.7	6.0	6.8	6.1	7.2	773	444		<1
06/15/26	0.6	6.0				7.1	604			<1	0.5	6.0				7.2	773			<1
06/16/26	0.6	6.0				7.1	619			<1	0.5	6.0				7.2	776			<1
06/17/26	0.6	5.4	7.2	7.7	7.2	7.0	634			1	0.5	5.4	7.2	7.7	7.2	7.2	776			<1
06/18/26	0.6	5.5				7.1	626			<1	0.5	5.5				7.2	780			<1
06/19/26	0.5	5.5				7.1	619			<1	0.5	5.5				7.2	776			<1
06/20/26	0.5	5.5				7.2	613			<1	0.5	5.5				7.2	775			1
06/21/26	0.5	5.5	5.7	6.5	5.7	7.1	596	442		1	0.5	5.5	5.7	6.5	5.7	7.2	779	442		<1
06/22/26	0.4	6.0				7.1	574			<1	0.5	6.0				7.2	777			<1
06/23/26	0.5	5.9				7.0	590			1	0.6	5.9				7.3	727			<1
06/24/26	0.5	5.7	5.6	6.8	5.5	7.1	580			1	0.6	5.7	5.6	6.8	5.5	7.3	695			<1
06/25/26	0.5	5.6				7.1	571			<1	0.6	5.6				7.3	698			<1
06/26/26	0.5	5.4				7.1	565			1	0.6	5.4				7.3	698			<1
06/27/26	0.5	5.5				7.1	554			<1	0.6	5.5				7.3	701			<1
06/28/26	0.5	5.5	6.6	7.4	6.6	7.1	535	424		<1	0.6	5.5	6.6	7.4	6.6	7.3	704	424		<1
06/29/26	0.4	5.7				7.1	508			2	0.6	5.7				7.3	714			<1
06/30/26	0.4	5.7				7.1	602			<1	0.6	5.7				7.3	725			<1
Avg	0.5	5.7	5.9	6.7	5.9	7.1	615	438	154	<1	0.5	5.7	5.9	6.7	5.9	7.2	756	438	161	<1
Min	0.4	5.4	4.7	5.5	4.8	7.0	508	424	154	<1	0.4	5.4	4.7	5.5	4.8	7.2	695	424	161	<1
Max	0.6	6.0	7.2	7.7	7.2	7.2	707	444	154	3	0.7	6.0	7.2	7.7	7.2	7.3	782	444	161	1

Note:

Bolded characters signify an exceedance of a permit limitation

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-2
Recycled Water Monitoring: Agency-Wide Flow-Weighted TIN & TDS (mg/L)

	TIN		TDS	
Date	Monthly	12-Mo. Run Avg.	Monthly	12-Mo. Run Avg.
Jul-25	6.0	6.0	481	468
Aug-25	6.0	6.0	477	470
Sep-25	5.7	6.0	475	473
Oct-25	5.8	6.0	451	472
Nov-25	5.4	5.9	455	470
Dec-25	6.1	5.9	476	470
Jan-26	5.6	5.9	462	471
Feb-26	5.2	5.8	473	472
Mar-26	5.7	5.8	463	471
Apr-26	5.8	5.8	467	469
May-26	6.2	5.8	446	467
Jun-26	5.9	5.8	459	465
Avg	5.8	5.9	465	470
Min	5.2	5.8	446	465
Max	6.2	6.0	481	473
Limit		8.0		550

Date source: IEUA NPDES monthly self-monitoring report (MRP No. R8-2022-0041).

Per the Regional Board, compliance with TDS limit is based on the 12-month flow-weighted TDS concentration of IEUA agency-wide discharged effluent and recycled water flows; compliance with TIN limit is based on 12-month flow-weighted TIN concentrations of IEUA agency-wide discharged effluent. Agency-wide TIN & TDS were in compliance with permit limits at all times.

Table 2-3a
Recycled Water Monitoring - RW Blend (RP1/RP-4): Primary & Secondary Maximum Contaminant Levels
(Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	3Q25	4Q25	1Q26	2Q26	4Q Run. Avg. ¹	Limit	Unit	Method
Inorganic Chemicals								
Aluminum	126	<25	<25	<25	<50	1000	µg/L	EPA 200.8
Antimony	<1	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic	<2	<2	<2	<2	<2	10	µg/L	EPA 200.8
Asbestos	NR	NR	<0.17	NR	<0.17	7	MFL	EPA 100.2
Barium	16	27	27	26	24	1000	µg/L	EPA 200.8
Beryllium	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium	<0.25	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Chromium VI ²	0.4	0.5	0.9	0.4	0.6	10	µg/L	EPA 218.6
Cyanide	<20	<20	<20	<20	<20	150	µg/L	OIA-1677, DW
Fluoride	0.2	0.2	0.3	0.2	0.2	2	mg/L	EPA 300.0
Mercury	<0.5	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.1
Nickel	3	2	2	2	2	100	µg/L	EPA 200.8
Perchlorate	<1	<1	<1	<1	<1	6	µg/L	EPA 314/331.0
Selenium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Thallium	<1	<1	<1	<1	<1	2	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)								
Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropene	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Monochlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl-tert-butyl ether	<0.5	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	0.6	0.6	0.6	<0.5	0.6	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
m,p-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5	1750 ³	µg/L	EPA 524.2
o-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5		µg/L	EPA 524.2
1,2,3-Trichloropropane (added 7/2017)	<0.001	<0.001	<0.001	<0.001	<0.001	0.005	µg/L	CASRL 524M-TCP
Non-Volatile Synthetic Organic Chemicals (SOCs)								
Alachlor (Alanex)	<0.1	<0.1	<0.1	<0.1	<0.1	2	µg/L	EPA 525.2
Atrazine	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	<2	18	µg/L	EPA 531.2
Chlordane	<2	<2	<2	<0.1	<2	0.1	µg/L	EPA 505/508.1
2,4-D	<0.4	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	4	5	<5	4	4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1/524.3
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<3.5	<3.6	<3.5	<3.6	<4	20	µg/L	EPA 549.2
Endothall	<20	<20	<20	<20	<20	100	µg/L	EPA 548.1
Endrin	<0.2	<0.2	<0.2	<0.1	<0.2	2	µg/L	EPA 505/508.1
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1/524.3
Glyphosate	<25	<25	<25	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.2	<0.2	<0.2	<0.01	<0.2	0.01	µg/L	EPA 505/508.1
Heptachlor Epoxide	<0.2	<0.2	<0.2	<0.01	<0.2	0.01	µg/L	EPA 505/508.1

Table 2-3a
Recycled Water Monitoring - RW Blend (RP1/RP-4): Primary & Secondary Maximum Contaminant Levels
(Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	3Q25	4Q25	1Q26	2Q26	4Q Run. Avg. ¹	Limit	Unit	Method
Hexachlorobenzene	<0.5	<0.5	<1	<0.5	<0.6	1	µg/L	EPA 525.2/508.1
Hexachlorocyclopentadiene	<0.5	<0.5	<4	<0.5	<1.4	50	µg/L	EPA 525.2
Lindane	<0.2	<0.2	<0.2	<0.2	<0.2	0.2	µg/L	EPA 505/508.1
Methoxychlor	<0.2	<0.2	<0.2	<10	<2.7	30	µg/L	EPA 505/508.1
Molinate	<0.5	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2/508.1
Oxamyl	<2	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<4	<10	<10	<0.5	<6	0.5	µg/L	EPA 505/508.1
PCB 1221	<4	<10	<10	<0.5	<6	0.5	µg/L	EPA 505/508.1
PCB 1232	<4	<10	<10	<0.5	<6	0.5	µg/L	EPA 505/508.1
PCB 1242	<4	<10	<10	<0.5	<6	0.5	µg/L	EPA 505/508.1
PCB 1248	<4	<10	<10	<0.5	<6	0.5	µg/L	EPA 505/508.1
PCB 1254	<4	<10	<10	<0.5	<6	0.5	µg/L	EPA 505/508.1
PCB 1260	<4	<10	<10	<0.5	<6	0.5	µg/L	EPA 505/508.1
Simazine	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<20	<20	<20	<1	<15	3	µg/L	EPA 505/508.1
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (<i>new Federal MCL effective June 25, 2024 are blue & italicized</i>) *								
Perfluorooctanoic acid (PFOA)	6.4	4.6	3.6	3.3	4.4	4.0* / 5.1 (NL)	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	<2	<2	<2	<4	<3	4.0* / 6.5 (NL)	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	<2	<2	<2	<4	<3	10*	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	<2	<2	<2	<4	<3	10*	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	<2	<2	<2	<4	<3	10*	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	<1	<1	<1	<1	<1	1*	unitless	EPA 537.1
Action Level Chemicals								
Copper	3.6	5.7	4.8	<3	3.8	1300	µg/L	EPA 200.8
Lead	<0.5	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides								
Combined Radium-226 and Radium 228	<3	<3	<3	<3	<3	5	pCi/L	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	<3	15	pCi/L	EPA 900.0/SM7110C
Tritium	<300	<300	<300	<300	<300	20,000	pCi/L	EPA 906
Strontium-90	<2	<2	<2	<2	<2	8	pCi/L	EPA 905
Gross Beta Particle Activity	22	14	34	37	27	50	pCi/L	EPA 900.0
Uranium	<1	<1	<1	<1	<1	20	pCi/L	EPA 200.8
Secondary Maximum Contaminant Level Chemicals								
Aluminum	126	<25	<25	<25	<50	200	µg/L	EPA 200.8
Copper	3.6	5.7	4.8	<3	4	1000	µg/L	EPA 200.8
Corrosivity	-1.0	-0.5	-0.2 (Non-Cor.)	-0.7	-0.6	Non-Cor.	SI	SM 2330B
Foaming Agents (MBAS) ⁴	<0.1	NR	NR	NR	<0.1	0.5	mg/L	S5540C/EPA 425.1
Iron ⁴	50	17	<15	23	26	300	µg/L	EPA 200.7
Manganese	6	9	5	5	6	50	µg/L	EPA 200.8
Methyl-tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Odor--Threshold ⁴	35	NR	NR	NR	15	3	TON	SM 2150B
Silver	<0.25	<0.25	<0.25	<0.25	<0.25	100	µg/L	EPA 200.8
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Zinc	25	32	35	39	26	5000	µg/L	EPA 200.8
Miscellaneous Regulated Constituents								
Oil & Grease ⁵	<2	<1	<1	<1	--	1	mg/L	EPA 1664
Disinfection Byproducts								
Bromate	<0.005	0.005	0.006	<0.005	0.005	0.010	mg/L	EPA 300.1/317
Chlorite	<0.02	<0.01	<0.01	<0.01	<0.01	1	mg/L	EPA 300.0
Alternative Compliance Point Data	DCZ-LYS-25	DCZ-LYS-25	DCZ-LYS-25	DCZ-LYS-25	<==TTHMs			
	DCZ-LYS-25	DCZ-LYS-25	DCZ-LYS-25	DCZ-LYS-35	<==HAA5			
	3Q25	4Q25	1Q26	2Q26				
Total Trihalomethanes (TTHMs)	<2	<2	<2	<2	<2	80	µg/L	EPA 524.2
Total Haloacetic Acids (HAA5)	<0.5	<0.5	<0.5	<0.5	<1	60	µg/L	SM 6251B/EPA 552.3

Table 2-3b
Recycled Water Monitoring - RP-1 (001B Effluent): Primary & Secondary Maximum Contaminant Levels
(Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	3Q25	4Q25	1Q26	2Q26	4Q Run. Avg. ¹	Limit	Unit	Method
Inorganic Chemicals								
Aluminum	145	135	171	84	134	1000	µg/L	EPA 200.8
Antimony	<1	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic	<2	<2	<2	<2	<2	10	µg/L	EPA 200.8
Asbestos	NR	NR	<0.17	NR	<0.17	7	MFL	EPA 100.2
Barium	14	17	13	11	14	1000	µg/L	EPA 200.8
Beryllium	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium	<0.25	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Chromium VI ²	0.3	0.3	1.0	0.5	0.5	10	µg/L	EPA 218.6
Cyanide	<20	<20	<20	<20	<20	150	µg/L	OIA-1677, DW
Fluoride	0.2	0.2	0.2	0.2	0.2	2	mg/L	EPA 300.0
Mercury	<0.5	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.1
Nickel	3	3	3	2	3	100	µg/L	EPA 200.8
Perchlorate	<1	<1	<1	<1	<1	6	µg/L	EPA 314/331.0
Selenium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Thallium	<1	<1	<1	<1	<1	2	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)								
Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropene	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Monochlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl-tert-butyl ether	<0.5	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	0.9	0.9	0.9	0.9	0.9	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
m,p-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5	1750 ³	µg/L	EPA 524.2
o-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5		µg/L	EPA 524.2
1,2,3-Trichloropropane (added 7/2017)	<0.001	<0.001	<0.001	<0.001	<0.001	0.005	µg/L	CASRL 524M-TCP
Non-Volatile Synthetic Organic Chemicals (SOCs)								
Alachlor (Alanex)	<0.1	<0.1	<0.1	<0.1	<0.1	2	µg/L	EPA 525.2
Atrazine	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<20	<2	<2	<7	18	µg/L	EPA 531.2
Chlordane	<2	<2	<2	<2	<2	0.1	µg/L	EPA 505/508.1
2,4-D	<0.4	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	3	4	<2	3	3	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<3.6	<3.5	<3.6	<3.6	<4	20	µg/L	EPA 549.2
Endothall	<20	<20	<20	<20	<20	100	µg/L	EPA 548.1
Endrin	<0.2	<0.2	<0.2	<0.2	<0.2	2	µg/L	EPA 505/508.1
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1/524.3
Glyphosate	<25	<25	<25	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.2	<0.2	<0.2	<0.2	<0.2	0.01	µg/L	EPA 505/508.1
Heptachlor Epoxide	<0.2	<0.2	<0.2	<0.2	<0.2	0.01	µg/L	EPA 505/508.1

Table 2-3b
Recycled Water Monitoring - RP-1 (001B Effluent): Primary & Secondary Maximum Contaminant Levels
(Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	3Q25	4Q25	1Q26	2Q26	4Q Run. Avg. ¹	Limit	Unit	Method
Hexachlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2
Lindane	<0.2	<0.2	<0.2	<0.2	<0.2	0.2	µg/L	EPA 505/508.1
Methoxychlor	<0.2	<0.2	<0.2	<0.2	<0.2	30	µg/L	EPA 505/508.1
Molinate	<0.5	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2
Oxamyl	<2	<20	<20	<2	<11	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<4	<10	<10	<10	<9	0.5	µg/L	EPA 505/508.1
PCB 1221	<4	<10	<10	<10	<9	0.5	µg/L	EPA 505/508.1
PCB 1232	<4	<10	<10	<10	<9	0.5	µg/L	EPA 505/508.1
PCB 1242	<4	<10	<10	<10	<9	0.5	µg/L	EPA 505/508.1
PCB 1248	<4	<10	<10	<10	<9	0.5	µg/L	EPA 505/508.1
PCB 1254	<4	<10	<10	<10	<9	0.5	µg/L	EPA 505/508.1
PCB 1260	<4	<10	<10	<10	<9	0.5	µg/L	EPA 505/508.1
Simazine	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<20	<20	<20	<20	<20	3	µg/L	EPA 505/508.1
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (<i>new Federal MCL effective June 25, 2024 are blue & italicized</i>)*								
Perfluorooctanoic acid (PFOA)	6.3	3.2	3.1	2.7	3.8	<i>4.0*</i> / 5.1 (NL)	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	<2	<2	<2	<4	<2.5	<i>4.0*</i> / 6.5 (NL)	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	<2	<2	<2	<4	<3	<i>10*</i>	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	<2	<2	<2	<4	<3	<i>10*</i>	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	<2	<2	<2	<4	<3	<i>10*</i>	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	<1	<1	<1	<1	<1	<i>1*</i>	unitless	EPA 537.1
Action Level Chemicals								
Copper	<3	3	3	<3	2	1300	µg/L	EPA 200.8
Lead	<0.5	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides								
Combined Radium-226 and Radium 228	<3	<3	<3	<3	<3	5	pCi/L	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	<3	15	pCi/L	EPA 900.0/SM7110C
Tritium	<300	<300	<300	<300	<300	20,000	pCi/L	EPA 906
Strontium-90	<2	<2	<2	<2	<2	8	pCi/L	EPA 905
Gross Beta Particle Activity	21	15	20	33	22	50	pCi/L	EPA 900.0
Uranium	<1	<1	<1	<1	<1	20	pCi/L	EPA 200.8
Secondary Maximum Contaminant Level Chemicals								
Aluminum	145	135	171	84	134	200	µg/L	EPA 200.8
Copper	<3	3.3	3.1	<3	3.1	1000	µg/L	EPA 200.8
Corrosivity	-0.2 (Non-Cor.)	-0.1 (Non-Cor.)	-0.2 (Non-Cor.)	-0.8	-0.3	Non-Cor.	SI	SM 2330B
Foaming Agents (MBAS) ⁴	<1	NR	NR	NR	<1	0.5	mg/L	S5540C/EPA 425.1
Iron ⁴	51	59	44	41	49	300	µg/L	EPA 200.7
Manganese	4	21	4	4	8	50	µg/L	EPA 200.8
Methyl-tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Odor--Threshold ⁴	6	NR	NR	NR	7	3	TON	SM 2150B
Silver	<0.25	<0.25	<0.25	<0.25	<0.25	100	µg/L	EPA 200.8
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Zinc	20	14	23	24	16	5000	µg/L	EPA 200.8
Miscellaneous Regulated Constituents								
Oil & Grease ⁵	<1	<1	<1	0.4	--	1	mg/L	EPA 1664
Disinfection Byproducts								
Bromate	<0.005	0.012	0.006	<0.005	0.007	0.010	mg/L	EPA 300.1/317
Chlorite	<0.01	<0.01	<0.01	<0.01	<0.01	1	mg/L	EPA 300.0

NR: Not required this quarter

¹ Non-detect (ND) is considered to be half the detection limit (DL) for the 4-quarter running average calculation. The reported 4-quarter running average value, if less than DL, will be based on highest DL found in the data set.

² As of September 11, 2017 the MCL for hexavalent chromium that was established in 2014 is no longer in effect; the State Board plans on establishing a new MCL in the near future.

³ The sum of m,p-Xylene and o-Xylene is used to calculate compliance for the Total Xylenes limit

⁴ 4-quarter running average is calculated based on the four most recent results. Monitoring is required annually. However, if monitoring takes place more frequently than required, those results will be reported.

⁵ Oil & Grease compliance determination is not based on 4-quarter running average. Compliance is evaluated based on an individual sample result.

Bold & yellow highlight signifies an exceedance of a limit in the Order. Explained in further detail in the report text.

Table 2-4a

Recycled Water Monitoring - RW Blend (RP1/RP-4): Remaining Priority Pollutants, EDCs & Pharmaceuticals, and Unregulated Chemicals
(Monitoring & Reporting Program)

Constituent	2Q26	Unit	Method	Constituent	2Q26	Unit	Method
Volatile Organic Chemicals (VOCs)				Pesticides			
Acrolein	NR	µg/L	EPA 624	Aldrin	NR	µg/L	EPA 508.1/608
Acrylonitrile	NR	µg/L	EPA 624	BHC, alpha isomer	<0.5	µg/L	EPA 508.1/608
Bromoform	<0.5	µg/L	EPA 524.2/624	BHC, beta isomer	<0.5	µg/L	EPA 508.1/608
Chlorodibromomethane	0.6	µg/L	EPA 524.2/624	BHC, delta isomer	<0.5	µg/L	EPA 508.1/608
Chloroethane	<0.5	µg/L	EPA 524.2/624	4,4'-DDT	<0.5	µg/L	EPA 508.1/608
2-Chloroethylvinylether	NR	µg/L	EPA 524.2/624	4,4'-DDE	<0.5	µg/L	EPA 508.1/608
Chloroform	85	µg/L	EPA 524.2/624	4,4'-DDD	<0.5	µg/L	EPA 508.1/608
Dichlorobromomethane	9	µg/L	EPA 524.2/624	Dieldrin	<0.5	µg/L	EPA 508.1/608
Methyl Bromide	<0.5	µg/L	EPA 524.2/624	Endosulfan I	<0.5	µg/L	EPA 508.1/608
Methyl Chloride	<0.5	µg/L	EPA 524.2/624	Endosulfan II	<0.5	µg/L	EPA 508.1/608
Acid Extractibles				Endosulfan Sulfate	<0.5	µg/L	EPA 508.1/608
2-Chlorophenol	NR	µg/L	EPA 625	Chemicals w/ State Notification Levels (NLS)			
2,4-Dichlorophenol	NR	µg/L	EPA 625	Boron	0.1	mg/L	EPA 200.7
2,4-Dimethylphenol	NR	µg/L	EPA 625	n-butylbenzene	<0.5	µg/L	EPA 524.2
2-Methyl-4,6-dinitrophenol	NR	µg/L	EPA 625	sec-butylbenzene	<0.5	µg/L	EPA 524.2
2,4-Dinitrophenol	NR	µg/L	EPA 625	tert-butylbenzene	<0.5	µg/L	EPA 524.2
2-Nitrophenol	NR	µg/L	EPA 625	Carbon disulfide	<0.5	µg/L	EPA 524.2
4-Nitrophenol	NR	µg/L	EPA 625	Chlorate ¹ (RW Blend /DCZ-LYS-25)	272 / <20	µg/L	EPA 300.0
4-Chloro-3-methylphenol	NR	µg/L	EPA 625	2-Chlorotoluene	<0.5	µg/L	EPA 524.2
Phenol	NR	µg/L	EPA 625	4-Chlorotoluene	<0.5	µg/L	EPA 524.2
2,4,6-Trichlorophenol	NR	µg/L	EPA 625	Diazinon	<0.5	µg/L	EPA 525.2
Base/Neutral Extractibles				Dichlorodifluoromethane (Freon 12)	<0.5	µg/L	EPA 524.2
Acenaphthene	NR	µg/L	EPA 625	1,4 - Dioxane	0.3	µg/L	EPA 522
Acenaphthylene	NR	µg/L	EPA 625	Ethylene glycol	<10	mg/L	EPA 8015B
Anthracene	NR	µg/L	EPA 625	Formaldehyde	55	µg/L	EPA 556
Benzidine	NR	µg/L	EPA 625	HMX	<4	µg/L	EPA 8330A
Benzo(a)anthracene	NR	µg/L	EPA 625	Isopropylbenzene	<0.5	µg/L	EPA 524.2
Benzo(b)fluoranthene	NR	µg/L	EPA 625	Manganese	5	µg/L	EPA 200.8
Benzo(g,h,i)perylene	NR	µg/L	EPA 625	Methyl isobutyl ketone (MIBK)	<2	µg/L	EPA 524.2
Benzo(k)fluoranthene	NR	µg/L	EPA 625	Naphthalene	<0.5	µg/L	EPA 525.2/524.2
Bis(2-chloroethoxy)methane	NR	µg/L	EPA 625	N-Nitrosodiethylamine (NDEA)	<2	ng/L	EPA 521
Bis(2-chloroethyl)ether	NR	µg/L	EPA 625	N-Nitrosodimethylamine (NDMA)	<2	ng/L	EPA 521
Bis(2-chloroisopropyl)ether	NR	µg/L	EPA 625	N-Nitroso-di-n-propylamine (NDPA)	<2	ng/L	EPA 521
4-Bromophenyl phenyl ether	NR	µg/L	EPA 625	Propachlor	<0.5	µg/L	EPA 525.2
Butyl benzyl phthalate	NR	µg/L	EPA 625	N-propylbenzene	<0.5	µg/L	EPA 524.2
2-Chloronaphthalene	NR	µg/L	EPA 625	RDX	<10	µg/L	EPA 8330A
4-Chlorophenyl phenyl ether	NR	µg/L	EPA 625	Tertiary butyl alcohol	2	µg/L	EPA 524.2
Chrysene	NR	µg/L	EPA 625	1,2,4-trimethylbenzene	<0.5	µg/L	EPA 524.2
Dibenzo(a,h)anthracene	NR	µg/L	EPA 625	1,3,5-trimethylbenzene	<0.5	µg/L	EPA 524.2
1,3-Dichlorobenzene	NR	µg/L	EPA 625	2,4,6-Trinitrotoluene	<4	µg/L	EPA 8330A
3,3-Dichlorobenzidine	NR	µg/L	EPA 625	Vanadium	<5	µg/L	EPA 200.8
Diethyl phthalate	NR	µg/L	EPA 625	Perfluorooctanoic acid (PFOA) ²	3.3	ng/L	EPA 537.1
Dimethyl phthalate	NR	µg/L	EPA 625	Perfluorooctanesulfonic acid (PFOS)	<4	ng/L	EPA 537.1
Di-n-butyl phthalate	NR	µg/L	EPA 625	Perfluorohexanesulfonic acid (PFHxS)	<4	ng/L	EPA 537.1
2,4-Dinitrotoluene	NR	µg/L	EPA 625	Perfluorohexanoic acid (PFHxA)	<4	ng/L	EPA 537.1
2,6-Dinitrotoluene	NR	µg/L	EPA 625	Perfluorobutanesulfonic acid (PFBS)	<4	ng/L	EPA 537.1
Di-n-octyl phthalate	NR	µg/L	EPA 625	Health-based and performance indicator CECs for Surface Application ³			
Azobenzene	NR	µg/L	EPA 625	1,4 - Dioxane	0.3	µg/L	EPA 522
Fluoranthene	NR	µg/L	EPA 625	N-nitrosodimethylamine (NDMA)	<2	ng/L	EPA 521
Fluorene	NR	µg/L	EPA 625	N-Nitrosomorpholine	2.8	ng/L	EPA 521
Hexachlorobutadiene	NR	µg/L	EPA 625	Perfluorooctanoic acid (PFOA)	3.3	ng/L	EPA 537.1
Hexachlorocyclopentadiene	NR	µg/L	EPA 625	Perfluorooctanesulfonic acid (PFOS)	<4	ng/L	EPA 537.1
Hexachloroethane	NR	µg/L	EPA 625	Gemfibrozil	<5	ng/L	EPA 1694
Indeno(1,2,3-cd)pyrene	NR	µg/L	EPA 625	Iohexol	2830	ng/L	EPA 1694
Isophorone	NR	µg/L	EPA 625	Sucralose	95100	ng/L	EPA 1694
Naphthalene	NR	µg/L	EPA 625	Sulfamethoxazole	<5	ng/L	EPA 1694
Nitrobenzene	NR	µg/L	EPA 625	ER-α (reported in avg BEQ/MTL)	0.008	ng/L	Indigo Biosciences
N-Nitroso-di-n-propylamine	NR	µg/L	EPA 625	AhR (reported in avg BEQ/MTL)	0.676	ng/L	Indigo Biosciences
N-Nitrosodiphenylamine	NR	µg/L	EPA 625	Bold & yellow highlight signifies an exceedance of a notification level			
Phenanthrene	NR	µg/L	EPA 625				
Pyrene	NR	µg/L	EPA 625				

NR: Not Required (Annual Requirement, Phase II FOF, Attachment A, Page 26, Item 19)

¹ Pursuant to the GRRP regulations, recharge water may be monitored at a monitoring well or lysimeter in lieu of recycled water for DDW-specified chemicals having notification levels.

² PFOA is being analyzed weekly for the exceedance of the NL and is reported in Section 2A of this report

³ Monitoring results for performance indicator CECs and surrogates shall be used to evaluate the operational performance and effectiveness of the treatment process in removing CECs and shall be compared to monitoring results from well RP3-1/1 to further assess treatment performance.

Table 2-4b

Recycled Water Monitoring - RP-1 (001B Effluent): Remaining Priority Pollutants, EDCs & Pharmaceuticals, and Unregulated Chemicals
(Monitoring & Reporting Program)

Constituent	2Q26	Unit	Method	Constituent	2Q26	Unit	Method
Volatile Organic Chemicals (VOCs)				Pesticides			
Acrolein	NR	µg/L	EPA 624	Aldrin	NR	µg/L	EPA 508.1/608
Acrylonitrile	NR	µg/L	EPA 624	BHC, alpha isomer	<0.2	µg/L	EPA 508.1/608
Bromoform	<0.5	µg/L	EPA 524.2/624	BHC, beta isomer	<0.2	µg/L	EPA 508.1/608
Chlorodibromomethane	1.3	µg/L	EPA 524.2/624	BHC, delta isomer	<0.2	µg/L	EPA 508.1/608
Chloroethane	<0.5	µg/L	EPA 524.2/624	4,4'-DDT	<0.2	µg/L	EPA 508.1/608
2-Chloroethylvinylether	NR	µg/L	EPA 524.2/624	4,4'-DDE	<0.2	µg/L	EPA 508.1/608
Chloroform	56	µg/L	EPA 524.2/624	4,4'-DDD	<0.2	µg/L	EPA 508.1/608
Dichlorobromomethane	11	µg/L	EPA 524.2/624	Dieldrin	<0.2	µg/L	EPA 508.1/608
Methyl Bromide	<0.5	µg/L	EPA 524.2/624	Endosulfan I	<0.2	µg/L	EPA 508.1/608
Methyl Chloride	<0.5	µg/L	EPA 524.2/624	Endosulfan II	<0.2	µg/L	EPA 508.1/608
Acid Extractibles				Endosulfan Sulfate	<0.2	µg/L	EPA 508.1/608
2-Chlorophenol	NR	µg/L	EPA 625	Chemicals w/ State Notification Levels (NLs)			NL
2,4-Dichlorophenol	NR	µg/L	EPA 625	Boron	0.1	mg/L	EPA 200.7
2,4-Dimethylphenol	NR	µg/L	EPA 625	n-butylbenzene	<0.5	µg/L	EPA 524.2
2-Methyl-4,6-dinitrophenol	NR	µg/L	EPA 625	sec-butylbenzene	<0.5	µg/L	EPA 524.2
2,4-Dinitrophenol	NR	µg/L	EPA 625	tert-butylbenzene	<0.5	µg/L	EPA 524.2
2-Nitrophenol	NR	µg/L	EPA 625	Carbon disulfide	<0.5	µg/L	EPA 524.2
4-Nitrophenol	NR	µg/L	EPA 625	Chlorate ¹ (001B Eff /DCZ-LYS-25)	240 / <20	µg/L	EPA 300.0
4-Chloro-3-methylphenol	NR	µg/L	EPA 625	2-Chlorotoluene	<0.5	µg/L	EPA 524.2
Phenol	NR	µg/L	EPA 625	4-Chlorotoluene	<0.5	µg/L	EPA 524.2
2,4,6-Trichlorophenol	NR	µg/L	EPA 625	Diazinon	<0.5	µg/L	EPA 525.2
Base/Neutral Extractibles				Dichlorodifluoromethane (Freon 12)	<0.5	µg/L	EPA 524.2
Acenaphthene	NR	µg/L	EPA 625	1,4 - Dioxane	0.2	µg/L	EPA 522
Acenaphthylene	NR	µg/L	EPA 625	Ethylene glycol	<10	mg/L	EPA 8015B
Anthracene	NR	µg/L	EPA 625	Formaldehyde	46	µg/L	EPA 556
Benzidine	NR	µg/L	EPA 625	HMX	<4	µg/L	EPA 8330A
Benzo(a)anthracene	NR	µg/L	EPA 625	Isopropylbenzene	<0.5	µg/L	EPA 524.2
Benzo(b)fluoranthene	NR	µg/L	EPA 625	Manganese	4	µg/L	EPA 200.8
Benzo(g,h,i)perylene	NR	µg/L	EPA 625	Methyl isobutyl ketone (MIBK)	<2	µg/L	EPA 524.2
Benzo(k)fluoranthene	NR	µg/L	EPA 625	Naphthalene	<0.5	µg/L	EPA 524.2
Bis(2-chloroethoxy)methane	NR	µg/L	EPA 625	N-Nitrosodiethylamine (NDEA)	<2	ng/L	EPA 521
Bis(2-chloroethyl)ether	NR	µg/L	EPA 625	N-Nitrosodimethylamine (NDMA)	2.3	ng/L	EPA 521
Bis(2-chloroisopropyl)ether	NR	µg/L	EPA 625	N-Nitrosodi-n-propylamine (NDPA)	<2	ng/L	EPA 521
4-Bromophenyl phenyl ether	NR	µg/L	EPA 625	Propachlor	<0.5	µg/L	EPA 525.2
Butyl benzyl phthalate	NR	µg/L	EPA 625	N-propylbenzene	<0.5	µg/L	EPA 524.2
2-Chloronaphthalene	NR	µg/L	EPA 625	RDX	<10	µg/L	EPA 8330A
4-Chlorophenyl phenyl ether	NR	µg/L	EPA 625	Tertiary butyl alcohol	<2	µg/L	EPA 524.2
Chrysene	NR	µg/L	EPA 625	1,2,4-trimethylbenzene	<0.5	µg/L	EPA 524.2
Dibenzo(a,h)anthracene	NR	µg/L	EPA 625	1,3,5-trimethylbenzene	<0.5	µg/L	EPA 524.2
1,3-Dichlorobenzene	NR	µg/L	EPA 625	2,4,6-Trinitrotoluene	<4	µg/L	EPA 8330A
3,3-Dichlorobenzidine	NR	µg/L	EPA 625	Vanadium	<5	µg/L	EPA 200.8
Diethyl phthalate	NR	µg/L	EPA 625	Perfluorooctanoic acid (PFOA) ²	2.7	ng/L	EPA 537.1
Dimethyl phthalate	NR	µg/L	EPA 625	Perfluorooctanesulfonic acid (PFOS)	<4	ng/L	EPA 537.1
Di-n-butyl phthalate	NR	µg/L	EPA 625	Perfluorohexanesulfonic acid (PFHxS)	<4	ng/L	EPA 537.1
2,4-Dinitrotoluene	NR	µg/L	EPA 625	Perfluorohexanoic acid (PFHxA)	<4	ng/L	EPA 537.1
2,6-Dinitrotoluene	NR	µg/L	EPA 625	Perfluorobutanesulfonic acid (PFBS)	<4	ng/L	EPA 537.1
Di-n-octyl phthalate	NR	µg/L	EPA 625	Health-based and performance indicator CECs for Surface Application ³			RP3-1/1
Azobenzene	NR	µg/L	EPA 625	1,4 - Dioxane	0.2	µg/L	EPA 522
Fluoranthene	NR	µg/L	EPA 625	N-nitrosodimethylamine (NDMA)	2.3	ng/L	EPA 521
Fluorene	NR	µg/L	EPA 625	N-Nitrosomorphline	7.3	ng/L	EPA 521
Hexachlorobutadiene	NR	µg/L	EPA 625	Perfluorooctanoic acid (PFOA)	2.7	ng/L	EPA 537.1
Hexachlorocyclopentadiene	NR	µg/L	EPA 625	Perfluorooctanesulfonic acid (PFOS)	<4	ng/L	EPA 537.1
Hexachloroethane	NR	µg/L	EPA 625	Gemfibrozil	<5	ng/L	EPA 1694
Indeno(1,2,3-cd)pyrene	NR	µg/L	EPA 625	Iohexol	15300	ng/L	EPA 1694
Isophorone	NR	µg/L	EPA 625	Sucralose	82600	ng/L	EPA 1694
Naphthalene	NR	µg/L	EPA 625	Sulfamethoxazole	<5	ng/L	EPA 1694
Nitrobenzene	NR	µg/L	EPA 625	ER-α (reported in avg BEQ/MTL)	0.015	ng/L	Indigo Biosciences
N-Nitroso-di-n-propylamine	NR	µg/L	EPA 625	AhR (reported in avg BEQ/MTL)	0.469	ng/L	Indigo Biosciences
N-Nitrosodiphenylamine	NR	µg/L	EPA 625	Bold & yellow highlight signifies an exceedance of a notification level			
Phenanthrene	NR	µg/L	EPA 625				
Pyrene	NR	µg/L	EPA 625				

NR: Not Required (Annual Requirement, Phase II FOF, Attachment A, Page 26, Item 19)

¹ Pursuant to the GRRP regulations, recharge water may be monitored at a monitoring well or lysimeter in lieu of recycled water for DDW-specified chemicals having notification levels.

² PFOA is being analyzed weekly for the exceedance of the NL and is reported in Section 2A of this report

³ Monitoring results for performance indicator CECs and surrogates shall be used to evaluate the operational performance and effectiveness of the treatment process in removing CECs and shall be compared to monitoring results from well RP3-1/1 to further assess treatment performance.

Table 2-5
Alternative Monitoring Plans: TOC & TN

Date	RW Blend*					Banana					Hickory				
mg/L==>	TOC	TOC-20 wk avg	TOC-4 sample avg	TN	TN - 2 sample avg	TOC (93% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (47% reduction)	TN - 2 sample avg	TOC (93% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (27% reduction)	TN - 2 sample avg
Limit ==>					10 mg/L (DDW)	16 mg/L (RWQCB)	Apr - June 2026 : 1.7; 1.8; 1.8 mg/L			5 mg/L (RWQCB)	16 mg/L (RWQCB)	Apr - June 2026 : 3.8; 3.8; 3.8 mg/L			5 mg/L (RWQCB)
03/30/26	6.38	5.70	6.17	3.4	4.2	0.45	0.40	0.43	1.8	2.2	0.45	0.40	0.43	2.5	3.1
04/02/26				4.1	3.8				2.2	2.0				3.0	2.8
04/06/26	6.00	5.72	6.15	4.8	4.5	0.42	0.40	0.43	2.6	2.4	0.42	0.40	0.43	3.5	3.3
04/09/26				5.0	4.9				2.6	2.6				3.6	3.6
04/13/26	5.85	5.72	6.10	4.4	4.7	0.41	0.40	0.43	2.3	2.5	0.41	0.40	0.43	3.2	3.4
04/16/26				5.6	5.0				2.9	2.6				4.1	3.6
04/20/26	5.97	5.73	6.05	5.4	5.5	0.42	0.40	0.42	2.9	2.9	0.42	0.40	0.42	4.0	4.0
04/23/26				5.7	5.6				3.0	3.0				4.2	4.1
04/27/26	5.77	5.73	5.90	4.8	5.3	0.40	0.40	0.41	2.6	2.8	0.40	0.40	0.41	3.5	3.9
04/30/26				5.3	5.1				2.8	2.7				3.9	3.7
05/04/26	5.99	5.74	5.90	4.8	5.1	0.42	0.40	0.41	2.6	2.7	0.42	0.40	0.41	3.5	3.7
05/07/26				6.6	5.7				3.5	3.0				4.8	4.2
05/11/26	5.95	5.76	5.92	5.0	5.8	0.42	0.40	0.41	2.6	3.1	0.42	0.40	0.41	3.6	4.2
05/14/26				4.7	4.9				2.5	2.6				3.5	3.5
05/18/26	5.88	5.75	5.90	4.6	4.7	0.41	0.40	0.41	2.4	2.5	0.41	0.40	0.41	3.4	3.4
05/21/26				5.1	4.9				2.7	2.6				3.7	3.5
05/25/26	5.44	5.76	5.82	5.0	5.0	0.38	0.40	0.41	2.6	2.7	0.38	0.40	0.41	3.6	3.7
05/28/26				4.8	4.9				2.6	2.6				3.5	3.6
06/01/26	5.68	5.79	5.74	4.6	4.7	0.40	0.41	0.40	2.4	2.5	0.40	0.41	0.40	3.3	3.4
06/04/26				4.9	4.8				2.6	2.5				3.6	3.5
06/08/26	5.75	5.82	5.69	4.4	4.7	0.40	0.41	0.40	2.3	2.5	0.40	0.41	0.40	3.2	3.4
06/11/26				5.2	4.8				2.8	2.5				3.8	3.5
06/15/26	5.59	5.83	5.62	5.3	5.3	0.39	0.41	0.39	2.8	2.8	0.39	0.41	0.39	3.9	3.8
06/18/26				5.3	5.3				2.8	2.8				3.8	3.9
06/22/26	5.50	5.84	5.63	4.8	5.0	0.39	0.41	0.39	2.5	2.7	0.39	0.41	0.39	3.5	3.7
06/25/26				5.7	5.2				3.0	2.8				4.1	3.8
06/29/26	5.71	5.85	5.64	6.2	5.9	0.40	0.41	0.39	3.3	3.1	0.40	0.41	0.39	4.5	4.3

*The RW blend of RP-1 & RP-4 effluent is sampled at the RP-4 1299 Pump Station. The TOC & TN values are used for the % reduction calculation of most of the GWR basins with the exception of the Ely Basins, which receives 001B Effluent.

Date	Turner 1 & 2					Turner 3 & 4					RP3				
mg/L==>	TOC (70% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (87% reduction)	TN - 2 sample avg	TOC (85% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (87% reduction)	TN - 2 sample avg	TOC (88% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (31% reduction)	TN - 2 sample avg
Limit ==>	16 mg/L (RWQCB)	Apr - June 2026 : 2.4; 2.5; 2.6 mg/L			5 mg/L (RWQCB)	16 mg/L (RWQCB)	Apr - June 2026 : 2.0; 2.0; 2.0 mg/L			5 mg/L (RWQCB)	16 mg/L (RWQCB)	Apr - June 2026 : 1.7; 1.7; 1.7 mg/L			5 mg/L (RWQCB)
03/30/26	1.91	1.71	1.85	0.4	0.5	0.96	0.86	0.93	0.4	0.5	0.77	0.68	0.74	2.4	2.9
04/02/26				0.5	0.5				0.5	0.5				2.8	2.6
04/06/26	1.80	1.72	1.85	0.6	0.6	0.90	0.86	0.92	0.6	0.6	0.72	0.69	0.74	3.3	3.1
04/09/26				0.6	0.6				0.6	0.6				3.4	3.4
04/13/26	1.76	1.72	1.83	0.6	0.6	0.88	0.86	0.92	0.6	0.6	0.70	0.69	0.73	3.0	3.2
04/16/26				0.7	0.6				0.7	0.6				3.8	3.4
04/20/26	1.79	1.72	1.82	0.7	0.7	0.90	0.86	0.91	0.7	0.7	0.72	0.69	0.73	3.7	3.8
04/23/26				0.7	0.7				0.7	0.7				4.0	3.8
04/27/26	1.73	1.72	1.77	0.6	0.7	0.87	0.86	0.88	0.6	0.7	0.69	0.69	0.71	3.3	3.6
04/30/26				0.7	0.7				0.7	0.7				3.6	3.5
05/04/26	1.80	1.72	1.77	0.6	0.7	0.90	0.86	0.88	0.6	0.7	0.72	0.69	0.71	3.3	3.5
05/07/26				0.9	0.7				0.9	0.7				4.5	3.9
05/11/26	1.79	1.73	1.78	0.6	0.8	0.89	0.86	0.89	0.6	0.8	0.71	0.69	0.71	3.4	4.0
05/14/26				0.6	0.6				0.6	0.6				3.3	3.4
05/18/26	1.76	1.73	1.77	0.6	0.6	0.88	0.86	0.88	0.6	0.6	0.71	0.69	0.71	3.2	3.2
05/21/26				0.7	0.6				0.7	0.6				3.5	3.3
05/25/26	1.63	1.73	1.74	0.6	0.7	0.82	0.86	0.87	0.6	0.7	0.65	0.69	0.70	3.4	3.5
05/28/26				0.6	0.6				0.6	0.6				3.3	3.4
06/01/26	1.70	1.74	1.72	0.6	0.6	0.85	0.87	0.86	0.6	0.6	0.68	0.69	0.69	3.1	3.2
06/04/26				0.6	0.6				0.6	0.6				3.4	3.3
06/08/26	1.73	1.75	1.71	0.6	0.6	0.86	0.87	0.85	0.6	0.6	0.69	0.70	0.68	3.0	3.2
06/11/26				0.7	0.6				0.7	0.6				3.6	3.3
06/15/26	1.68	1.75	1.68	0.7	0.7	0.84	0.87	0.84	0.7	0.7	0.67	0.70	0.67	3.7	3.6
06/18/26				0.7	0.7				0.7	0.7				3.6	3.7
06/22/26	1.65	1.75	1.69	0.6	0.7	0.83	0.88	0.84	0.6	0.7	0.66	0.70	0.68	3.3	3.5
06/25/26				0.7	0.7				0.7	0.7				3.9	3.6
06/29/26	1.71	1.75	1.69	0.8	0.8	0.86	0.88	0.85	0.8	0.8	0.69	0.70	0.68	4.2	4.1

Table 2-5
Alternative Monitoring Plans: TOC & TN

Date	8th Street					Victoria					San Sevaïne 1-3				
mg/L==>	TOC (93% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (75% reduction)	TN - 2 sample avg.	TOC (91% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (82% reduction)	TN - 2 sample avg.	TOC (92% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (34% reduction)	TN - 2 sample avg.
Limit ==>	16 mg/L (RWQCB)	Apr - June 2026 : 2.0; 2.1; 2.1 mg/L			5 mg/L (RWQCB)	16 mg/L (RWQCB)	Apr - June 2026 : 2.1; 2.1; 2.1 mg/L			5 mg/L (RWQCB)	16 mg/L (RWQCB)	Apr - June 2026 : 2.5; 2.4; 2.4 mg/L			5 mg/L (RWQCB)
03/30/26	0.45	0.40	0.43	0.9	1.1	0.57	0.51	0.56	0.9	1.1	0.51	0.46	0.49	2.3	2.8
04/02/26				1.0	0.9				1.0	0.9				2.7	2.5
04/06/26	0.42	0.40	0.43	1.2	1.1	0.54	0.51	0.55	1.2	1.1	0.48	0.46	0.49	3.2	2.9
04/09/26				1.2	1.2				1.2	1.2				3.3	3.2
04/13/26	0.41	0.40	0.43	1.1	1.2	0.53	0.51	0.55	1.1	1.2	0.47	0.46	0.49	2.9	3.1
04/16/26				1.4	1.2				1.4	1.2				3.7	3.3
04/20/26	0.42	0.40	0.42	1.4	1.4	0.54	0.52	0.54	1.4	1.4	0.48	0.46	0.48	3.6	3.6
04/23/26				1.4	1.4				1.4	1.4				3.8	3.7
04/27/26	0.40	0.40	0.41	1.2	1.3	0.52	0.52	0.53	1.2	1.3	0.46	0.46	0.47	3.2	3.5
04/30/26				1.3	1.3				1.3	1.3				3.5	3.3
05/04/26	0.42	0.40	0.41	1.2	1.3	0.54	0.52	0.53	1.2	1.3	0.48	0.46	0.47	3.2	3.3
05/07/26				1.6	1.4				1.6	1.4				4.3	3.8
05/11/26	0.42	0.40	0.41	1.2	1.4	0.54	0.52	0.53	1.2	1.4	0.48	0.46	0.47	3.3	3.8
05/14/26				1.2	1.2				1.2	1.2				3.1	3.2
05/18/26	0.41	0.40	0.41	1.2	1.2	0.53	0.52	0.53	1.2	1.2	0.47	0.46	0.47	3.0	3.1
05/21/26				1.3	1.2				1.3	1.2				3.4	3.2
05/25/26	0.38	0.40	0.41	1.2	1.3	0.49	0.52	0.52	1.2	1.3	0.44	0.46	0.47	3.3	3.3
05/28/26				1.2	1.2				1.2	1.2				3.2	3.2
06/01/26	0.40	0.41	0.40	1.1	1.2	0.51	0.52	0.52	1.1	1.2	0.45	0.46	0.46	3.0	3.1
06/04/26				1.2	1.2				1.2	1.2				3.3	3.1
06/08/26	0.40	0.41	0.40	1.1	1.2	0.52	0.52	0.51	1.1	1.2	0.46	0.47	0.46	2.9	3.1
06/11/26				1.3	1.2				1.3	1.2				3.4	3.2
06/15/26	0.39	0.41	0.39	1.3	1.3	0.50	0.52	0.51	1.3	1.3	0.45	0.47	0.45	3.5	3.5
06/18/26				1.3	1.3				1.3	1.3				3.5	3.5
06/22/26	0.39	0.41	0.39	1.2	1.3	0.50	0.53	0.51	1.2	1.3	0.44	0.47	0.45	3.2	3.3
06/25/26				1.4	1.3				1.4	1.3				3.7	3.5
06/29/26	0.40	0.41	0.39	1.5	1.5	0.51	0.53	0.51	1.5	1.5	0.46	0.47	0.45	4.1	3.9

Date	Declez					Brooks				
mg/L==>	TOC (62% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (91% reduction)	TN - 2 sample avg.	TOC (92% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (83% reduction)	TN - 2 sample avg.
Limit ==>	16 mg/L (RWQCB)	Apr - June 2026 : 7.1; 7.1; 7.1 mg/L			5 mg/L (RWQCB)	16 mg/L (RWQCB)	Apr - June 2026 : 4.5; 4.5; 4.5 mg/L			5 mg/L (RWQCB)
03/30/26	2.42	2.17	2.34	0.3	0.4	0.51	0.46	0.49	0.6	0.7
04/02/26				0.4	0.3				0.7	0.6
04/06/26	2.28	2.17	2.34	0.4	0.4	0.48	0.46	0.49	0.8	0.8
04/09/26				0.4	0.4				0.8	0.8
04/13/26	2.22	2.17	2.32	0.4	0.4	0.47	0.46	0.49	0.7	0.8
04/16/26				0.5	0.4				0.9	0.8
04/20/26	2.27	2.18	2.30	0.5	0.5	0.48	0.46	0.48	0.9	0.9
04/23/26				0.5	0.5				1.0	0.9
04/27/26	2.19	2.18	2.24	0.4	0.5	0.46	0.46	0.47	0.8	0.9
04/30/26				0.5	0.5				0.9	0.9
05/04/26	2.28	2.18	2.24	0.4	0.5	0.48	0.46	0.47	0.8	0.9
05/07/26				0.6	0.5				1.1	1.0
05/11/26	2.26	2.19	2.25	0.4	0.5	0.48	0.46	0.47	0.8	1.0
05/14/26				0.4	0.4				0.8	0.8
05/18/26	2.23	2.19	2.24	0.4	0.4	0.47	0.46	0.47	0.8	0.8
05/21/26				0.5	0.4				0.9	0.8
05/25/26	2.07	2.19	2.21	0.4	0.5	0.44	0.46	0.47	0.8	0.9
05/28/26				0.4	0.4				0.8	0.8
06/01/26	2.16	2.20	2.18	0.4	0.4	0.45	0.46	0.46	0.8	0.8
06/04/26				0.4	0.4				0.8	0.8
06/08/26	2.19	2.21	2.16	0.4	0.4	0.46	0.47	0.46	0.7	0.8
06/11/26				0.5	0.4				0.9	0.8
06/15/26	2.13	2.22	2.13	0.5	0.5	0.45	0.47	0.45	0.9	0.9
06/18/26				0.5	0.5				0.9	0.9
06/22/26	2.09	2.22	2.14	0.4	0.5	0.44	0.47	0.45	0.8	0.9
06/25/26				0.5	0.5				1.0	0.9
06/29/26	2.17	2.22	2.14	0.6	0.5	0.46	0.47	0.45	1.0	1.0

Table 2-5
Alternative Monitoring Plans: TOC & TN

Date	001B Effluent *					Ely 3 East (001B Effluent)*					
mg/L==>	TOC	TOC-20 wk avg	TOC-4 sample avg	TN	TN - 2 sample avg	TOC (86% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (52% reduction)	TN - 2 sample avg	
Limit ==>					10 mg/L (DDW)	16 mg/L (RWQCB)	Apr - June 2026 : 2.6; 2.6; 2.6 mg/L			5 mg/L (RWQCB)	
03/30/26	7.05			4.5	5.2	0.99			2.1	2.5	
04/02/26	6.50	6.48	6.89	5.5	5.0	0.91	0.91	0.96	2.7	2.4	
04/06/26	6.54			6.3	5.9	0.92			3.0	2.8	
04/09/26	6.76	6.50	6.56	6.1	6.2	0.95	0.91	0.92	2.9	3.0	
04/13/26	6.70			6.4	6.3	0.94			3.1	3.0	
04/16/26	6.39	6.52	6.62	5.6	6.0	0.89	0.91	0.93	2.7	2.9	
04/20/26	6.59			6.9	6.3	0.92			3.3	3.0	
04/23/26	6.63	6.53	6.60	6.8	6.9	0.93	0.91	0.92	3.3	3.3	
04/27/26	6.62			7.4	7.1	0.93			3.6	3.4	
04/30/26	6.52	6.55	6.58	7.2	7.3	0.91	0.92	0.92	3.5	3.5	
05/04/26	6.21			6.5	6.8	0.87			3.1	3.3	
05/07/26	6.67	6.55	6.44	7.2	6.8	0.93	0.92	0.90	3.4	3.3	
05/11/26	6.37			7.1	7.1	0.89			3.4	3.4	
05/14/26	6.57	6.54	6.41	6.9	7.0	0.92	0.92	0.90	3.3	3.4	
05/18/26	6.10			6.6	6.8	0.85			3.2	3.3	
05/21/26	6.15	6.54	6.17	5.9	6.3	0.86	0.92	0.86	2.8	3.0	
05/25/26	5.56			7.1	6.5	0.78			3.4	3.1	
05/28/26	6.13	6.52	5.78	6.3	6.7	0.86	0.91	0.81	3.0	3.2	
06/01/26	5.65			6.6	6.4	0.79			3.2	3.1	
06/04/26	5.95	6.48	5.77	5.5	6.0	0.83	0.91	0.81	2.6	2.9	
06/08/26	5.53			6.5	6.0	0.77			3.1	2.9	
06/11/26	5.90	6.45	5.80	6.4	6.4	0.83	0.90	0.81	3.0	3.1	
06/15/26	5.73			6.8	6.6	0.80			3.3	3.2	
06/18/26	5.45	6.41	5.71	7.7	7.2	0.76	0.90	0.80	3.7	3.5	
06/22/26	5.54			6.5	7.1	0.78			3.1	3.4	
06/25/26	5.72	6.36	5.66	6.8	6.6	0.80	0.89	0.79	3.2	3.2	
06/29/26	5.49			7.4	7.1	0.77			3.6	3.4	

* 001B Effluent is RP-1 Recycled water that is delivered to the Ely Basins.

Title 22 §60320.118(c) Analytical results of the TOC monitoring performed pursuant to subsection (a) shall not exceed 0.5 mg/L divided by the running monthly average (RMA) RWC based on: (1) the 20-week running average of all TOC results; and (2) the average of the last four TOC results." TOCavg limits are calculated and can be found in Table 2-6.

Table 2-6
RWC, TOC Average, and TN Compliance Summary

Basin	SUP Start Date	SUP End Date	SUP Report Submittal	RWC Limit (120-MRA)	Months in Operation (Mar 2026)	Month	RWC _{Avg} (120-MRA)	TOC _{Avg} in mg/L Limit ¹	Max TOC _{Avg} in mg/L (20-wk avg)	Max TOC _{Avg} (20-wk avg) Compliance	Max TOC _{Avg} in mg/L (4-sample avg)	Max TOC _{Avg} (4-sample avg) Compliance	Max TN in mg/L (2-sample avg)	TN 10 mg/L DDW Limit ² Compliance	Recharged Water Monitoring Plan
7 th & 8 th Street	Sep-07	Dec-10	05/23/11	50%	226	Apr-26	25%	2.0	0.4	Met	0.4	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 93% (based on 10-year average reduction from 2014 to 2023 at 8TH-1/1) and TN reduction of 75%
						May-26	24%	2.1	0.4	Met	0.4	Met	5.8	Met	
						Jun-26	24%	2.1	0.4	Met	0.4	Met	5.9	Met	
Banana	Jul-05	Jan-06	10/27/06	50%	252	Apr-26	29%	1.7	0.4	Met	0.4	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 93% (based on 10-year average reduction from 2014 to 2023 at BH-1/2) and TN reduction of 47%
						May-26	28%	1.8	0.4	Met	0.4	Met	5.8	Met	
						Jun-26	28%	1.8	0.4	Met	0.4	Met	5.9	Met	
Brooks	Aug-08	Dec-09	07/29/10	50%	215	Apr-26	11%	4.5	0.5	Met	0.5	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 92% (based on 10-year average reduction from 2014 to 2023 at BRK-1/1) and TN reduction of 83%.
						May-26	11%	4.5	0.5	Met	0.5	Met	5.8	Met	
						Jun-26	11%	4.5	0.5	Met	0.5	Met	5.9	Met	
Declez	Dec-15	Sep-16	05/21/18	initial 20%	127	Apr-26	7%	7.1	2.2	Met	2.3	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 62% and TN reduction of 91%
						May-26	7%	7.1	2.2	Met	2.2	Met	5.8	Met	
						Jun-26	7%	7.1	2.2	Met	2.2	Met	5.9	Met	
Ely ³	RW initiated Sep-99	NA	NA	50%	322	Apr-26	19%	2.6	0.9	Met	1.0	Met	7.3	Met	Alternative monitoring: <u>Weekly</u> RP-1 RW sample with TOC reduction of 86% (based on 10-year average reduction from 2009 to 2018 at Ely MW1) and TN reduction of 52%
						May-26	19%	2.6	0.9	Met	0.9	Met	7.1	Met	
						Jun-26	19%	2.6	0.9	Met	0.8	Met	7.2	Met	
Hickory	Sep-05	Feb-06	02/15/07	50%	250	Apr-26	13%	3.8	0.4	Met	0.4	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 93% (based on 10-year average reduction from 2014 to 2023 at BH-1/2) and TN reduction of 27%
						May-26	13%	3.8	0.4	Met	0.4	Met	5.8	Met	
						Jun-26	13%	3.8	0.4	Met	0.4	Met	5.9	Met	
RP3	Jun-09	Jun-10	12/15/10	50%	205	Apr-26	29%	1.7	0.7	Met	0.7	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 88% and TN reduction of 31%
						May-26	29%	1.7	0.7	Met	0.7	Met	5.8	Met	
						Jun-26	29%	1.7	0.7	Met	0.7	Met	5.9	Met	
San Sevaine 1-3	Aug-20	Sep-21	02/08/22	50%	71	Apr-26	20%	2.5	0.5	Met	0.5	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 92% and TN reduction of 34%
						May-26	21%	2.4	0.5	Met	0.5	Met	5.8	Met	
						Jun-26	21%	2.4	0.5	Met	0.5	Met	5.9	Met	
Turner 1&2	Dec-06	May-07	07/03/08	24%	235	Apr-26	21%	2.4	1.7	Met	1.8	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 70%; TN reduction of 87%
						May-26	20%	2.5	1.7	Met	1.8	Met	5.8	Met	
						Jun-26	19%	2.6	1.8	Met	1.7	Met	5.9	Met	
Turner 3&4	Dec-06	May-07	07/03/08	45%	235	Apr-26	25%	2.0	0.9	Met	0.9	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 85% ; TN reduction of 87%
						May-26	25%	2.0	0.9	Met	0.9	Met	5.8	Met	
						Jun-26	25%	2.0	0.9	Met	0.9	Met	5.9	Met	
Victoria	Sep-10	Jul-11	02/08/12	50%	190	Apr-26	24%	2.1	0.5	Met	0.6	Met	5.6	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 91% (based on 10-year average reduction from 2014 to 2023 at VCT-1/1) and TN reduction of 82%
						May-26	24%	2.1	0.5	Met	0.5	Met	5.8	Met	
						Jun-26	24%	2.1	0.5	Met	0.5	Met	5.9	Met	

SUP - Start-Up Period

MRA: Monthly Running Average - The RWC Limit and the RWC avg are based on 120-month running average

Max TOC_{avg} : Maximum calculated TOC_{avg} value for each month from Table 2-5.

TOC 20-week average and 4-sample averages are pursuant to Title 22 §60320.118(c): "Analytical results of the TOC monitoring performed pursuant to subsection (a) shall not exceed 0.5 mg/L divided by the RMA RWC"

¹ TOC_{Avg} limit is 0.5 mg/L divided by the RWC_{Avg}. Compliance is determined by checking that monthly TOC_{Avg} does not exceed the TOC_{Avg} limit. If the TOC_{Avg} limit is exceeded, the monthly TOC_{Avg} will be bolded.

² TN limit is 10 mg/L based on a two-sample average of the RW Blend and 001B Effluent.

³ Ely Basin receives 001B Effluent, which is RP-1 effluent only. All other basins receive RW Blend, which is a blend of RP-1 & RP-4 recycled water.

Table 2-7a
Diluent Water Monitoring*: [Local Runoff](#)/ [Stormwater](#)

Constituent	Local Runoff	Max Level to Trigger	Unit	Method
	West Cucamonga Creek @ Ely Basin 05/20/26	Source Water Evaluation		
NO ₂ -N	<0.05	1	mg/L	EPA 300.0
NO ₃ -N	<0.1	10	mg/L	EPA 300.0
TDS	332	1000	mg/L	SM 2540C
Total Coliform	5400	-	mpn/100ml	SM 9221B
Oil & Grease	<1	-	mg/L	EPA 1664A
Inorganic Chemicals				
Aluminum	<25	1000	µg/L	EPA 200.7
Antimony	1	6	µg/L	EPA 200.8
Arsenic	<2	10	µg/L	EPA 200.8
Asbestos	<0.2	7	MFL	EPA 100.2
Barium	36	1000	µg/L	EPA 200.8
Beryllium	<0.5	4	µg/L	EPA 200.8
Cadmium	<0.25	5	µg/L	EPA 200.8
Chromium	<2	50	µg/L	EPA 200.8
Chromium VI	3.4	10	µg/L	EPA 218.6
Cyanide	<20	150	µg/L	ASTM D7284/OIA-1677
Fluoride	0.30	2	mg/L	SM 4500-F C
Mercury	<0.5	2	µg/L	EPA 245.2
Nickel	1	100	µg/L	EPA 200.8
Perchlorate	<1	6	µg/L	EPA 314
Selenium	<2	50	µg/L	EPA 200.8
Thallium	<1	2	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)				
Benzene	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropene	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	300	µg/L	EPA 524.2
Chlorobenzene	<0.5	70	µg/L	EPA 524.2
Methyl Tert-butyl ether (MTBE)	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	5	µg/L	EPA 524.2
Toluene	<0.5	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	0.5	µg/L	EPA 524.2
Total Xylenes	<0.5	1750	µg/L	EPA 524.2
1,2,3-Trichloropropane	<0.001	0.005	µg/L	CASRL 524M-TCP
Non-Volatile Synthetic Organic Chemicals (SOCs)				
Alachlor (Alanex)	<4	2	µg/L	EPA 508.1/525.2
Atrazine	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	18	µg/L	EPA 531.2
Chlordane	<2	0.1	µg/L	EPA 505/508.1
2,4-D	<0.4	70	µg/L	EPA 515.4
Dalapon	<0.4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	0.2	µg/L	EPA 504.1/EPA 524.3
Di(2-ethylhexyl)adipate	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	7	µg/L	EPA 515.4
Diquat	<3.6	20	µg/L	EPA 549.2
Endothall	<20	100	µg/L	EPA 548.1
Endrin	<0.2	2	µg/L	EPA 505/508.1
Ethylene Dibromide	<0.02	0.05	µg/L	EPA 504.1
Glyphosate	<25	700	µg/L	EPA 547
Heptachlor	<0.2	0.01	µg/L	EPA 505/508.1
Heptachlor Epoxide	<0.2	0.01	µg/L	EPA 505/508.1
Hexachlorobenzene	<0.5	1	µg/L	EPA 525.2/EPA508.1
Hexachlorocyclopentadiene	<0.5	50	µg/L	EPA 525.2/EPA508.1
Lindane	<0.2	0.2	µg/L	EPA 505/508.1
Methoxychlor	<0.2	30	µg/L	EPA 505/508.1
Molinate	<0.5	20	µg/L	EPA 525.2

Table 2-7a
Diluent Water Monitoring*: Local Runoff/ Stormwater

Constituent	Local Runoff	Max Level to Trigger	Unit	Method
	West Cucamonga Creek @ Ely Basin 05/20/26	Source Water Evaluation		
Oxamyl	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	500	µg/L	EPA 515.4
PCB 1016	<10	0.5	µg/L	EPA 505/508.1
PCB 1221	<10	0.5	µg/L	EPA 505/508.1
PCB 1232	<10	0.5	µg/L	EPA 505/508.1
PCB 1242	<10	0.5	µg/L	EPA 505/508.1
PCB 1248	<10	0.5	µg/L	EPA 505/508.1
PCB 1254	<10	0.5	µg/L	EPA 505/508.1
PCB 1260	<10	0.5	µg/L	EPA 505/508.1
Simazine	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	70	µg/L	EPA 525.2
Toxaphene	<20	3	µg/L	EPA 505/508.1
2,3,7,8-TCDD (Dioxin)	<50	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	50	µg/L	EPA 515.4
Disinfection Byproducts				
Total Trihalomethanes (TTHMs)	<0.5	80	µg/L	EPA 524.2/624
Total Haloacetic Acids (HAA5)	1.7	60	µg/L	SM 6251B/EPA 552.3
Bromate	<0.005	0.01	mg/L	EPA 300.1/317
Chlorite	<0.01	1	mg/L	EPA 300.0
Action Level Chemicals				
Copper	10	1300	µg/L	EPA 200.8
Lead	1	15	µg/L	EPA 200.8
Radionuclides				
Combined Radium-226 & Radium 228	<3	5	pCi/L	EPA 903.0
Gross Alpha Particle Activity	<3	15	pCi/L	EPA 900.0/SM7110C
Tritium	<300	20,000	pCi/L	EPA 906.0
Strontium-90	<3	8	pCi/L	EPA 905.0
Gross Beta Particle Activity	11	50	pCi/L	EPA 900.0
Uranium	5	20	pCi/L	EPA 200.8
Chemicals w/ State Notification Levels				
Boron	<0.1	1	mg/L	EPA 200.7
n-butylbenzene	<0.5	260	µg/L	EPA 524.2
sec-butylbenzene	<0.5	260	µg/L	EPA 524.2
tert-butylbenzene	<0.5	260	µg/L	EPA 524.2
Carbon disulfide	<0.5	160	µg/L	EPA 524.2
Chlorate	32	800	µg/L	EPA 300.0
2-Chlorotoluene	<0.5	140	µg/L	EPA 524.2
4-Chlorotoluene	<0.5	140	µg/L	EPA 524.2
Diazinon	<0.5	1.2	µg/L	EPA 525.2
Dichlorodifluoromethane (Freon 12)	<0.5	1000	µg/L	EPA 524.2
1,4 - Dioxane	0.11	1	µg/L	EPA 522
Ethylene glycol	<20	14	mg/L	EPA 8015B/504.1
Formaldehyde	22	100	µg/L	EPA 556
HMX	<50	350	µg/L	EPA 8330A
Isopropylbenzene	<0.5	770	µg/L	EPA 524.2
Manganese	5	500	µg/L	EPA 200.8
Methyl isobutyl ketone (MIBK)	<2	120	µg/L	EPA 524.2
Naphthalene	<0.5	17	µg/L	EPA 524.2
N-Nitrosodiethylamine (NDEA)	<2	10	ng/L	EPA 521
N-nitrosodimethylamine (NDMA)	<2	10	ng/L	EPA 521
N-Nitrosodi-n-propylamine (NDPA)	<2	10	ng/L	EPA 521
PFOA	9.1	4.0** / 5.1 (NL)	ng/L	EPA 537.1
PFOS	6.3	4.0** / 5.1 (NL)	ng/L	EPA 537.1
Propachlor	<0.5	90	µg/L	EPA 525.2
N-propylbenzene	<0.5	200	µg/L	EPA 524.2
RDX	<50	0.3	µg/L	EPA 8330A
Tertiary butyl alcohol	<2	12	µg/L	EPA 524.2
1,2,4 –trimethylbenzene	<0.5	330	µg/L	EPA 524.2
1,3,5-trimethylbenzene	<0.5	330	µg/L	EPA 524.2
2,4,6-Trinitrotoluene	<50	1	µg/L	EPA 8330A
Vanadium	13	50	µg/L	EPA 200.8
Secondary Maximum Contaminant Level Chemicals***				
Aluminum	<25	--	µg/L	EPA 200.8
Corrosivity	1.4	--	SI	SM 2330B
Foaming Agents (MBAS)	<0.1	--	mg/L	SM 5540C/EPA 425.1
Iron	68	--	µg/L	EPA 200.7
Manganese	5	--	µg/L	EPA 200.7
Odor-- Threshold	8	--	TON	SM 2150B
Silver	<0.25	--	µg/L	EPA 200.7
Thiobencarb	<0.5	--	µg/L	EPA 525.2
Zinc	30	--	µg/L	EPA 200.7

* Diluent monitoring is monitored per the schedule identified in the CDPH-approved Diluent Water Monitoring Plan

** New Federal MCL effective June 25, 2024 are italicized

*** Max level to trigger source water evaluation do not apply to secondary (aesthetic) MCLs

NA: Not available at time of reporting

Bold & yellow highlight signifies an exceedance of the maximum level to trigger a source water evaluation.

Table 2-7b
Diluent Water Monitoring: State Water Project - Silverwood Lake

Constituent	Jan-26	Feb-26	Mar-26	Apr-26	May-26	Jun-26	Jul-26	Aug-26	Sep-26	Oct-26	Nov-26	Dec-26	Unit
Silica	11.9	11.2	11.6	10.2	8.2	Not Available	Not Available	Not Available	Not Available	Not Available	Not Available	Not Available	mg/L
Calcium	18	21	21	19	19								mg/L
Magnesium	10	12	12	10	10								mg/L
Sodium	46	55	48	36	36								mg/L
Potassium	3.0	3.2	3.3	2.8	2.6								mg/L
Carbonate	0	0	0	0	0								mg/L
Bicarbonate	84	94	94	87	89								mg/L
Sulfate	23	30	33	35	34								mg/L
Chloride	69	80	65	44	45								mg/L
Nitrate	2.0	2.4	2.8	2.6	1.9								mg/L
Fluoride	<0.1	<0.1	<0.1	<0.1	<0.1	Not Available	Not Available	Not Available	Not Available	Not Available	Not Available	Not Available	mg/L
Total Dissolved Solids	225	262	244	203	201								mg/L
Total Hardness as CaCO ₃	88	101	96	90	88								mg/L
Total Alkalinity as CaCO ₃	69	77	77	71	73								mg/L
Free Carbon Dioxide	1.7	1.3	0.9	1.3	1.2								mg/L
pH	7.91	8.08	8.23	8.05	8.11								unit
Specific Conductance	418	485	443	372	365								µmho/cm
Color	15	--	--	15	--								CU
Turbidity	8.0	2.0	3.2	2.1	1.5								NTU
Temperature	11	15	12	17	17								°C
Bromide	0.22	0.26	0.19	0.12	0.12								mg/L
Total Organic Carbon	4.89	3.38	4.58	5.28	4.60								mg/L

Table 2-8
Summary of Wells in Groundwater Monitoring Networks

BASIN	CBWM_ID	OWNER/LOCAL NAME	SEPARATION DISTANCE (feet)	SCREENED INTERVAL(S) (feet bgs)	CASING DIAMETER (inches)	STATUS	TYPE
Hickory and Banana Basins	600490	Fontana Water Company - F7a ³	3330 upgradient	590-1000	18	Active	Municipal
	--	Fontana Water Company - F7b ⁵	3100 upgradient	600-990	20	Active	Municipal
	600660	California Speedway - Infield Well	2070 downgradient	NA	NA	Active	Industrial
	601002	Inland Empire Utilities Agency - BH-1/2	340 downgradient	435-475	4	Active	Monitoring
	--	Inland Empire Utilities Agency - BH-2/1 ⁶	4635 downgradient	560-600	4	Active	Monitoring
Turner Basins	600453	City Of Ontario - 29	2810 downgradient	400-1095	18	Active	Municipal
	600585	City of Ontario - 38 ¹	4600 crossgradient	500-1010	16	Active	Municipal
	600998	Inland Empire Utilities Agency - T-1/2	50 downgradient	380-400	4	Active	Monitoring
	601000	Inland Empire Utilities Agency - T-2/2	50 downgradient	392-412	4	Active	Monitoring
Declez Basin	300208	Jurupa Community Services District - 19	8900 downgradient	230-390	18	Active	Municipal
	300207	Jurupa Community Services District - 17	5240 downgradient	259-290, & 300-400	NA	Active	Municipal
	300200	Jurupa Community Services District - 13	5730 downgradient	220-446	16-34	Active	Municipal
	300484	Inland Empire Utilities Agency - DCZ-1/1	50 downgradient	155-175	4	Active	Monitoring
	--	Inland Empire Utilities Agency - DCZ-2	4,100 downgradient	240-270	4	Active	Monitoring
RP3 Basins	600492	Fontana Water Company - F23a	7900 upgradient	450-740	18	Active	Municipal
	600477	Inland Empire Utilities Agency - Southridge JHS	5500 downgradient	NA	NA	Active	Monitoring
	600848	Alcoa - Offsite MW1	9480 downgradient	NA	NA	Active	Monitoring
	600850	Alcoa - Offsite MW3	4725 downgradient	NA	NA	Active	Monitoring
	601040	Inland Empire Utilities Agency - RP3-1/1	100 downgradient	215-235	4	Active	Monitoring
Jurupa Basin	Not currently planned for recharge						
7th & 8th Street Basins	600493	City of Ontario No. 35	9695 downgradient	580-1020	18-36	Active	Municipal
	601036	Inland Empire Utilities Agency - 8TH-1/1	150 downgradient	495-535	4	Active	Monitoring
	601037	Inland Empire Utilities Agency - 8TH-1/2	150 downgradient	595-645	4	Active	Monitoring
	601038	Inland Empire Utilities Agency - 8TH-2/1	2460 downgradient	465-505	4	Active	Monitoring
	601039	Inland Empire Utilities Agency - 8TH-2/2	2460 downgradient	576-616	4	Active	Monitoring
Brooks Basins	1901719	City of Pomona P-10	1983 downgradient	295-784	20	Active	Municipal
	1904001	City of Pomona P-34	2550 downgradient	363-367,380-400, 419-427	20	Active	Municipal
	601050	Inland Empire Utilities Agency - BRK-1/1	144 downgradient	310-350	4	Active	Monitoring
	601051	Inland Empire Utilities Agency - BRK-1/2	144 downgradient	520-560	4	Active	Monitoring
	601048	Inland Empire Utilities Agency - BRK-2/1	1305 downgradient	320-360	4	Active	Monitoring
	601049	Inland Empire Utilities Agency - BRK-2/2	1305 downgradient	560-600	4	Active	Monitoring
San Seavine Basins	600905	Cucamonga Valley Water District No. 39	8300-13170 downgradient	750-870, 940-960, 970-1060, & 1080-1130,	20	Active	Municipal
	601115	Inland Empire Utilities Agency - SS-1/1	~39-116 downgradient	640-680	4	Active	Monitoring
	--	Inland Empire Utilities Agency - SSV-2	200 downgradient	370-395	4	Active	Monitoring
	600462	Unitex 91090	~1601 downgradient	NA	NA	Active	Private Domestic
Victoria Basin	600905	Cucamonga Valley Water District No. 39	4329 downgradient	750-870, 940-960, 970-1060, & 1080-1130,	20	Active	Municipal
	601033	Cucamonga Valley Water District No. 43 ²	8300 downgradient	650-800	32-42	Active	Municipal
	601117	Inland Empire Utilities Agency - VCT-1/1	~39-116 downgradient	570-610	4	Active	Monitoring
	--	Inland Empire Utilities Agency - VCT-2/2	~ 2000 downgradient	570-610	4	Active	Monitoring
Ely Basin	--	Inland Empire Utilities Agency - Ely-3 ⁴	100 downgradient	246-306	4	Active	Monitoring
	601004	Ely Basin MW-2, Walnut Well (Casing 2)	3050 downgradient	290 - 310	4	Active	Monitoring
	3600975	Riverside Drive Well (43840-CWW)	6046 downgradient	NA	NA	Active	Private Irrigation
	600134	Bishop Of San Bernardino Corp. - DOM	6500 downgradient	NA	NA	Active	Private Domestic

Notes:

- NA = Data not available
 CBWM ID = Chino Basin Water Master well identification number
 bgs = below ground surface
¹ = Ontario Well No. 38 replaced Ontario Well No. 19, which is inactive
² = Cucamonga Valley Water District No. 43 replaced CVWD Well Nos. 35 & 36, which are inactive.
³ = Fontana Water Company Well 7A replaced Fontana Water Company Well 37A (1Q18)
⁴ = Inland Empire Utilities Agency Ely-3 replaced Ely Basin MW-1, Philadelphia Well (Casing 3)
⁵ =Fontana Water Company Well 7B sampled when Fontana Water Company Well 7A is out of service
⁶ = Inland Empire Utilities Agency BH-2/1 replaced Reliant Energy, East Well

Table 2-9
Groundwater Monitoring Well Results (Quarterly)

	Sample Location	Date	TOC (mg/L)	Total Coliform (MPN/100mL)	pH	EC (µmho/cm)	Al (µg/L)	Color (units)	Cu (µg/L)	Corrosivity Index (SI)	Foaming Agents (mg/L)	Fe (µg/L)	Mn (µg/L)	MTBE (µg/L)	Odor Threshold (TON)	Ag (µg/L)	Thiocarb (µg/L)	Turbidity (NTU)	Zn (µg/L)	TDS (mg/L)	Cl (mg/L)	Hardness (mg CaCO ₃ /L)	Na (mg/L)	SO ₄ (mg/L)	Nitrogen, Total (mg/L)	NO ₂ -N (mg/L)	NO ₃ -N (mg/L)	Dissolved Oxygen (mg/L)
Banana & Hickory	Fontana Water Co. - F7a	04/22/26	<0.3	<1.1	6.9	358	<25	<5	<3	-0.6	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	232	9	161	19	13	3.5	<0.05	3.5	8.4
	BH-1/2*	05/26/26	<0.3	<1.1	7.9	462	<25	<5	<3	0.4	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.2	<2	272	47	192	23	27	0.9	<0.05	0.9	8.0
	BH-2/1*	05/11/26	<0.3	<1.1	7.5	594	<25	<5	<3	0.1	<0.1	<15	3	<0.5	<1	<0.25	<0.5	0.3	2	370	81	246	21	32	3.5	<0.05	3.5	8.7
	BH-2/2*	05/11/26	<0.3	<1.1	7.6	388	<25	<5	<3	0.1	<0.1	<15	2	<0.5	<1	<0.25	<0.5	<0.1	<2	270	20	162	21	15	6.4	<0.05	6.4	8.8
Turner	T-1/2*	05/04/26	0.4	<1.1	7.4	598	<25	<5	<3	0.0	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.2	<2	332	71	195	58	19	<0.6	<0.05	<0.1	2.2
	T-2/2*	05/04/26	0.4	<1.1	7.6	517	<25	<5	<3	-0.1	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	1.0	<2	300	70	144	57	25	0.7	<0.05	0.7	2.3
RP3	Alcoa MW1*	05/13/26	<0.3	15	7.7	678	<25	<5	<3	0.4	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.2	<2	426	118	269	27	26	2.8	<0.05	2.8	8.5
	Alcoa MW3*	05/13/26	<0.3	<1.1	7.2	900	<25	<5	<3	0.1	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	556	120	348	50	55	11.7	<0.05	11.7	8.6
	Fontana Water Co. - F23a	04/22/26	<0.3	<1.1	7.8	366	<25	<5	<3	0.3	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.2	<2	226	12	158	19	19	5.4	<0.05	5.4	8.2
	Southridge JHS*	05/19/26	0.3	1300	7.1	918	<25	5	<3	0.0	<0.1	<15	2	<0.5	<1	<0.25	<0.5	5	5	556	85	346	55	69	15.7	<0.05	15.7	7.5
	RP3-1/1*	05/19/26	0.5	31	7.0	696	<25	<5	<3	-0.5	<0.1	<15	2	<0.5	<1	<0.25	<0.5	1.5	<2	430	96	147	83	39	4.9	<0.05	4.9	2.7
7th & 8th Street	Ontario Well No. 35	04/01/26	<0.3	6.3	7.2	341	<25	<5	<3	-0.4	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	216	7	135	23	18	3.3	<0.05	3.3	7.9
	8TH-1/1*	04/30/26	0.3	<1.1	7.5	415	<25	55	<3	-0.3	<0.1	<15	3	<0.5	<1	<0.25	<0.5	31.0	<2	280	63	150	28	14	3.2	<0.05	3.2	6.3
	8TH-1/2*	04/30/26	<0.3	<1.1	7.3	518	<25	10	<3	-0.2	<0.1	<15	19	<0.5	<1	<0.25	<0.5	13.3	<2	338	69	227	18	28	1.2	<0.05	1.2	4.2
	8TH-2/1*	04/27/26	<0.3	<1.1	7.5	481	<25	<5	<3	0.1	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.5	<2	286	31	235	14	18	5.4	<0.05	5.4	9.0
	8TH-2/2*	04/27/26	<0.3	<1.1	7.6	433	<25	15	<3	-0.1	<0.1	93	8	<0.5	<1	<0.25	<0.5	15.8	<2	282	51	188	16	26	2.1	<0.05	2.1	6.5
Brooks	Pomona Well No. 10	05/04/26	<0.3	<1.1	7.7	496	<25	<5	<3	0.3	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	300	40	236	14	37	6.5	<0.05	6.5	9.4
	BRK-1/1*	04/28/26	<0.3	<1.1	7.6	504	<25	5	<3	0.1	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	4.1	<2	296	35	211	28	37	6.5	<0.05	6.5	10.3
	BRK-1/2*	04/28/26	<0.3	<1.1	7.7	644	<25	<5	<3	0.4	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	366	19	304	15	33	13.8	<0.05	13.8	10.8
	BRK-2/1*	05/12/26	<0.3	15	7.6	533	<25	<5	<3	0.2	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.4	<2	340	41	253	11	38	6.8	<0.05	6.8	9.1
	BRK-2/2*	05/12/26	<0.3	<1.1	8.2	391	<25	<5	<3	0.5	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.2	<2	238	12	133	32	25	10.4	<0.05	10.4	6.5
Ely	Ely Basin MW2 Walnut St.*	05/18/26	0.4	<1.1	7.3	1076	<25	<5	<3	0.4	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.2	<2	672	80	483	37	70	26.5	<0.05	26.5	7.4
	Ely-3*	05/26/26	0.6	<1.1	7.2	442	<25	<5	<3	-0.6	<0.1	<15	1	<0.5	<1	<0.25	<0.5	0.2	<2	254	48	106	54	21	<0.6	<0.05	0.5	1.7
	Riverside Well (43840-CWW)*	04/21/26	<0.3	<1.1	7.5	585	<25	<5	<3	0.2	<0.1	<15	4	<0.5	<1	<0.25	<0.5	<0.1	21	358	36	262	21	33	9.2	<0.05	9.2	7.5
	Bishop of SB Corp. - DOM	04/22/26	<0.3	<1.1	7.4	872	<25	<5	<3	0.4	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.1	58	542	41	419	25	67	21.2	<0.05	21.2	6.6
Victoria & San Seavaine	SS-1/1*	04/29/26	<0.3	<1.1	7.3	322	<25	<5	<3	-0.6	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.9	<2	228	30	127	17	21	3.5	<0.05	3.5	8.5
	SSV-2*	04/29/26	0.5	<1.1	7.5	575	28	5	<3	0.1	<0.1	31	2	<0.5	<1	<0.25	<0.5	15.3	<2	344	58	197	51	39	2.8	<0.05	2.8	6.1
	VCT-1/1*	05/07/26	0.5	2.0	7.1	513	<25	<5	<3	-0.3	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	1.2	<2	312	66	206	24	28	<0.6	<0.05	0.2	22.2
	VCT-2/2*	05/07/26	<0.3	<1.1	7.6	382	<25	<5	<3	0.0	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.2	<2	230	20	157	20	17	6.4	<0.05	6.4	9.3
	CVWD Well No. 39	04/21/26	<0.3	<1.1	6.9	278	<25	<5	42.5	-0.9	<0.1	32	1	<0.5	<1	<0.25	<0.5	0.3	9	190	6	113	18	10	4.3	<0.05	4.3	8.2
	CVWD Well No. 43	04/21/26	<0.3	<1.1	7.5	352	<25	<5	<3	-0.1	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	0.1	<2	236	14	139	19	16	4.0	<0.05	4.0	8.9
	Unitex 91090*	05/14/26	<0.3	<1.1	7.7	480	<25	<5	<3	0.1	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	292	55	205	15	30	1.8	<0.05	1.8	6.5
Declerz	JCSD Well No. 13	04/20/26	<0.3	<1.1	7.8	633	<25	<5	<3	0.5	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	414	74	262	28	34	9.0	<0.05	9.0	7.8
	JCSD Well No. 17	04/20/26	<0.3	<1.1	7.8	543	<25	<5	<3	0.5	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	334	52	214	29	37	7.8	<0.05	7.8	6.8
	JCSD Well No. 19	04/20/26	<0.3	<1.1	7.5	355	<25	<5	<3	0.0	<0.1	<15	<1	<0.5	<1	<0.25	<0.5	<0.1	<2	222	13	137	27	15	4.9	<0.05	4.9	8.3
	DCZ-2*	05/14/26	<0.3	<1.1	7.8	594	<25	<5	<3	0.4	<0.1	<15	4	<0.5	<1	<0.25	<0.5	1.0	153	348	77	210	38	42	6.0	<0.05	6.0	8.1
	Detection Limit		0.3	1			25	5	3.0		0.10	15	1	1	1	0.25	0.50	0.1	2		2	1	5	2	0.6	0.05	0.1	
	Primary Maximum Contaminant Level						1000		1300					13			70									1	10	
	Secondary Maximum Contaminant Level				6.5-8.5	900	200	15	1000		0.5	300	50	5	3	100	1	5	5000	500	250			250				

Blank cells indicate that analysis was not run for a constituent on that particular date. On certain dates, supplemental analysis was conducted on several monitoring wells. On those occasions, a full set of analysis was not necessary and only parameters of interest were analyzed.

* Total dissolved metals reported for these wells. The remaining wells report total recoverable metals values.

Table 3-1
Diluent & Recycled Water Recharge Volume (Acre-Feet)

	Diluent Water																				Recycled Water											
	Imported Water										Local Runoff / Storm Flow																					
Date	7th & 8th St.	Banana	Brooks	Declez	Ely	Hickory	RP3	San Sevaïne	Turner	Victoria	7th & 8th St.	Banana	Brooks	Declez	Ely	Hickory	RP3	San Sevaïne	Turner	Victoria	7th & 8th St.	Banana	Brooks	Declez	Ely	Hickory	RP3	San Sevaïne	Turner	Victoria		
Jul-25	0	0	0	0	0	0	0	0	0	0	7	0	12	15	93	0	0	0	25	1	270	78	73	175	91	78	116	107	226	138		
Aug-25	0	0	0	0	0	0	0	0	0	0	7	0	0	17	62	0	0	0	37	2	338	81	34	192	185	81	128	120	67	152		
Sep-25	0	0	0	0	0	0	0	0	0	0	6	0	0	16	14	0	0	0	27	2	233	55	40	182	201	55	176	417	153	134		
3Q25 Total	0	0	0	0	0	0	0	0	0	0	20	0	12	48	169	0	0	0	89	5	841	214	148	549	477	214	420	644	447	424		
Oct-25	0	0	0	0	0	0	0	0	0	0	133	12	25	76	241	21	11	44	65	19	182	35	13	92	151	35	967	440	86	65		
Nov-25	0	0	0	0	0	0	0	0	0	0	192	51	144	106	329	46	283	296	213	116	83	13	0	61	23	29	929	228	27	7		
Dec-25	0	0	0	0	0	0	0	0	18	0	129	35	108	81	264	54	221	410	227	118	81	14	0	78	77	9	926	246	33	0		
4Q25 Total	0	0	0	0	0	0	0	0	18	0	453	98	277	264	834	121	515	750	505	253	346	62	13	231	251	73	2822	913	146	73		
Jan-26	0	0	0	0	0	0	0	0	0	0	56	17	65	65	84	14	358	209	92	51	35	17	14	74	75	15	714	336	25	0		
Feb-26	0	0	0	0	0	0	0	0	0	0	139	26	106	97	257	56	223	290	195	82	26	2	0	16	29	2	585	229	13	13		
Mar-26	0	0	0	0	0	0	0	0	0	0	10	0	0	12	1	0	64	0	9	1	73	48	26	114	161	48	719	623	24	24		
1Q26 Total	0	0	0	0	0	0	0	0	0	0	205	43	171	173	342	70	645	499	296	134	134	67	39	204	265	65	2019	1188	62	37		
Apr-26	0	0	0	0	0	0	0	0	0	0	100	11	36	59	69	42	61	47	24	9	19	6	28	66	151	4	587	607	0	59		
May-26	0	0	0	0	0	0	0	0	0	0	4	0	33	14	14	0	6	1	0	2	27	0	59	69	229	0	629	613	0	90		
Jun-26	0	0	0	0	0	0	0	0	0	0	5	0	56	9	5	0	0	0	0	1	0	0	0	29	284	0	392	599	0	90		
2Q26 Total	0	0	0	0	0	0	0	0	0	0	109	11	126	82	87	42	67	48	24	12	46	6	87	163	664	4	1608	1819	0	239		

Table 6-1
MVWD ASR Project - TIN/TDS Mass Balance

ASR Well No. 4										
	Date	Injection			Recovery			Mass Balance		
		Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)
3Q25	Jul-25	0.0	0.3	260	0	13.0	400	(2,527)	(44,818)	(1,237,716)
	Aug-25	0.0	0.3	260	0	13.0	400	(2,527)	(44,818)	(1,237,716)
	Sep-25	0.0	0.3	260	0	13.0	400	(2,527)	(44,818)	(1,237,716)
4Q25	Oct-25	0.0	0.3	190	0	13.0	400	(2,527)	(44,818)	(1,237,716)
	Nov-25	0.0	0.3	190	0	13.0	400	(2,527)	(44,818)	(1,237,716)
	Dec-25	0.0	0.3	190	0	13.0	400	(2,527)	(44,818)	(1,237,716)
1Q26	Jan-26	0.0	0.5	250	0	13.0	400	(2,527)	(44,818)	(1,237,716)
	Feb-26	0.0	0.5	250	0	13.0	400	(2,527)	(44,818)	(1,237,716)
	Mar-26	0.0	0.5	250	0	13.0	400	(2,527)	(44,818)	(1,237,716)
2Q26	Apr-26	0.0	0.6	220	19	13.0	400	(2,547)	(45,128)	(1,247,249)
	May-26	0.0	0.6	220	0	13.0	400	(2,547)	(45,128)	(1,247,249)
	Jun-26	0.0	0.6	220	0	13.0	400	(2,547)	(45,128)	(1,247,249)

ASR Well No. 30										
	Date	Injection			Recovery			Mass Balance		
		Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)
3Q25	Jul-25	0.0	0.3	260	8	12.0	250	(772)	(63,188)	(751,915)
	Aug-25	0.0	0.3	260	17	12.0	250	(790)	(63,445)	(757,281)
	Sep-25	0.0	0.3	260	238	12.0	250	(1,028)	(66,975)	(830,825)
4Q25	Oct-25	0.0	0.3	190	249	12.0	250	(1,277)	(70,655)	(907,480)
	Nov-25	0.0	0.3	190	131	12.0	250	(1,408)	(72,600)	(947,996)
	Dec-25	0.0	0.3	190	0	12.0	250	(1,408)	(72,600)	(947,996)
1Q26	Jan-26	0.0	0.5	250	8	12.0	250	(1,416)	(72,724)	(950,593)
	Feb-26	0.0	0.5	250	0	12.0	250	(1,416)	(72,724)	(950,593)
	Mar-26	0.0	0.5	250	0	12.0	250	(1,416)	(72,724)	(950,593)
2Q26	Apr-26	0.0	0.6	220	0	12.0	250	(1,416)	(72,724)	(950,593)
	May-26	0.0	0.6	220	1	12.0	250	(1,417)	(72,736)	(950,846)
	Jun-26	0.0	0.6	220	2	12.0	250	(1,419)	(72,769)	(951,531)

ASR Well No. 32										
	Date	Injection			Recovery			Mass Balance		
		Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)
3Q25	Jul-25	0.0	0.3	260	0	12.0	330	(2,568)	(48,371)	(662,706)
	Aug-25	0.0	0.3	260	0	12.0	330	(2,568)	(48,371)	(662,706)
	Sep-25	0.0	0.3	260	0	12.0	330	(2,568)	(48,371)	(662,706)
4Q25	Oct-25	0.0	0.3	190	0	12.0	330	(2,568)	(48,371)	(662,706)
	Nov-25	0.0	0.3	190	0	12.0	330	(2,568)	(48,371)	(662,706)
	Dec-25	0.0	0.3	190	0	12.0	330	(2,568)	(48,371)	(662,706)
1Q26	Jan-26	0.0	0.5	250	5	12.0	330	(2,574)	(48,450)	(664,876)
	Feb-26	0.0	0.5	250	7	12.0	330	(2,580)	(48,547)	(667,539)
	Mar-26	0.0	0.5	250	123	12.0	330	(2,703)	(50,369)	(717,653)
2Q26	Apr-26	0.0	0.6	220	239	12.0	330	(2,942)	(53,905)	(814,877)
	May-26	0.0	0.6	220	241	12.0	330	(3,183)	(57,473)	(913,010)
	Jun-26	0.0	0.6	220	15	12.0	330	(3,199)	(57,700)	(919,254)

The injected water is WFA-treated water, which meets CCR Title 22 drinking water standards.

Cells shaded in grey reflect most recent lab values.


Table 6-1
MVWD ASR Project - TIN/TDS Mass Balance

ASR Well No. 33										
	Date	Injection			Recovery			Mass Balance		
		Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)
3Q25	Jul-25	0.0	0.3	260	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Aug-25	0.0	0.3	260	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Sep-25	0.0	0.3	260	0	12.0	320	(2,061)	(79,681)	(1,153,705)
4Q25	Oct-25	0.0	0.3	190	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Nov-25	0.0	0.3	190	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Dec-25	0.0	0.3	190	0	12.0	320	(2,061)	(79,681)	(1,153,705)
1Q26	Jan-26	0.0	0.5	250	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Feb-26	0.0	0.5	250	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Mar-26	0.0	0.5	250	0	12.0	320	(2,061)	(79,681)	(1,153,705)
2Q26	Apr-26	0.0	0.6	220	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	May-26	0.0	0.6	220	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Jun-26	0.0	0.6	220	0	12.0	320	(2,061)	(79,681)	(1,153,705)


The injected water is WFA-treated water, which meets CCR Title 22 drinking water standards.

Cells shaded in grey reflect most recent lab values.

Total Project (All Wells)					
	Date		Mass Balance		
			Storage (AF)	TIN (kg)	TDS (kg)
3Q25	Jul-25		(7,929)	(236,058)	(3,806,042)
	Aug-25		(7,947)	(236,316)	(3,811,408)
	Sep-25		(8,185)	(239,846)	(3,884,952)
4Q25	Oct-25		(8,434)	(243,526)	(3,961,608)
	Nov-25		(8,565)	(245,470)	(4,002,124)
	Dec-25		(8,565)	(245,470)	(4,002,124)
1Q26	Jan-26		(8,579)	(245,674)	(4,006,890)
	Feb-26		(8,585)	(245,771)	(4,009,553)
	Mar-26		(8,709)	(247,593)	(4,059,667)
2Q26	Apr-26		(8,967)	(251,438)	(4,166,425)
	May-26		(9,209)	(255,019)	(4,264,810)
	Jun-26		(9,226)	(255,279)	(4,271,740)

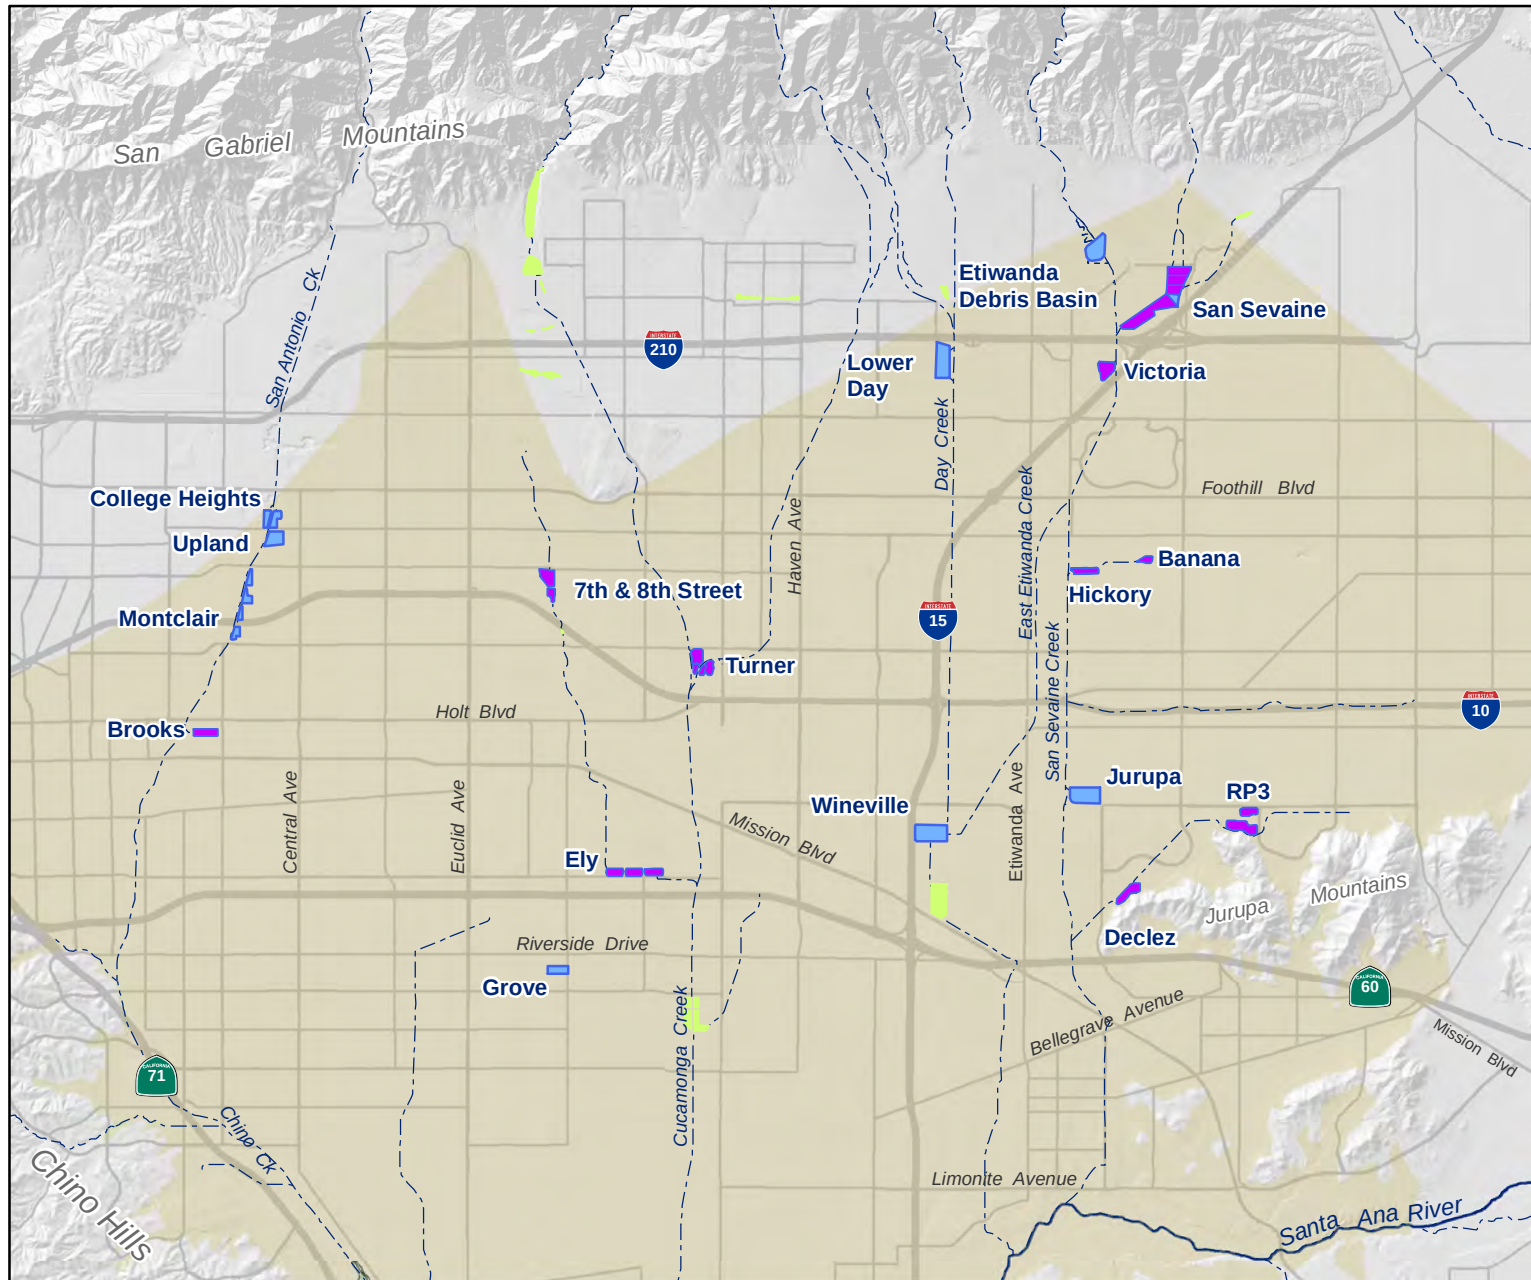

- Recharge Basins in the Recycled Water Groundwater Recharge Program
- Recharge Basins in the Recycled Water Groundwater Recharge Program (Active Recycled Water Recharge)
- Non-Program Basins
- Chino Groundwater Basin
- Rivers and Streams

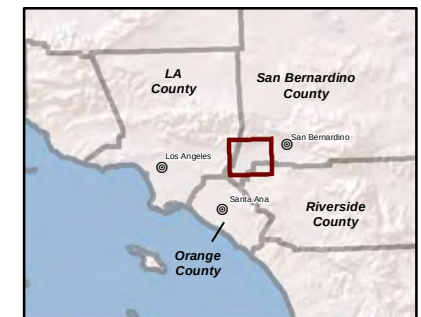

Chino Basin Recycled Water Groundwater Recharge Program
Basin Locations

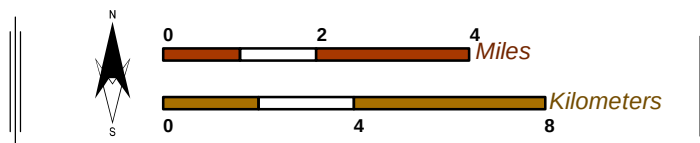


Figure 1-1



Main Map Features


- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin

Monitoring Well Network


Hickory and Banana Basins

Figure 2-1

Recycled Water Recharge Program



Date: 8/6/2025

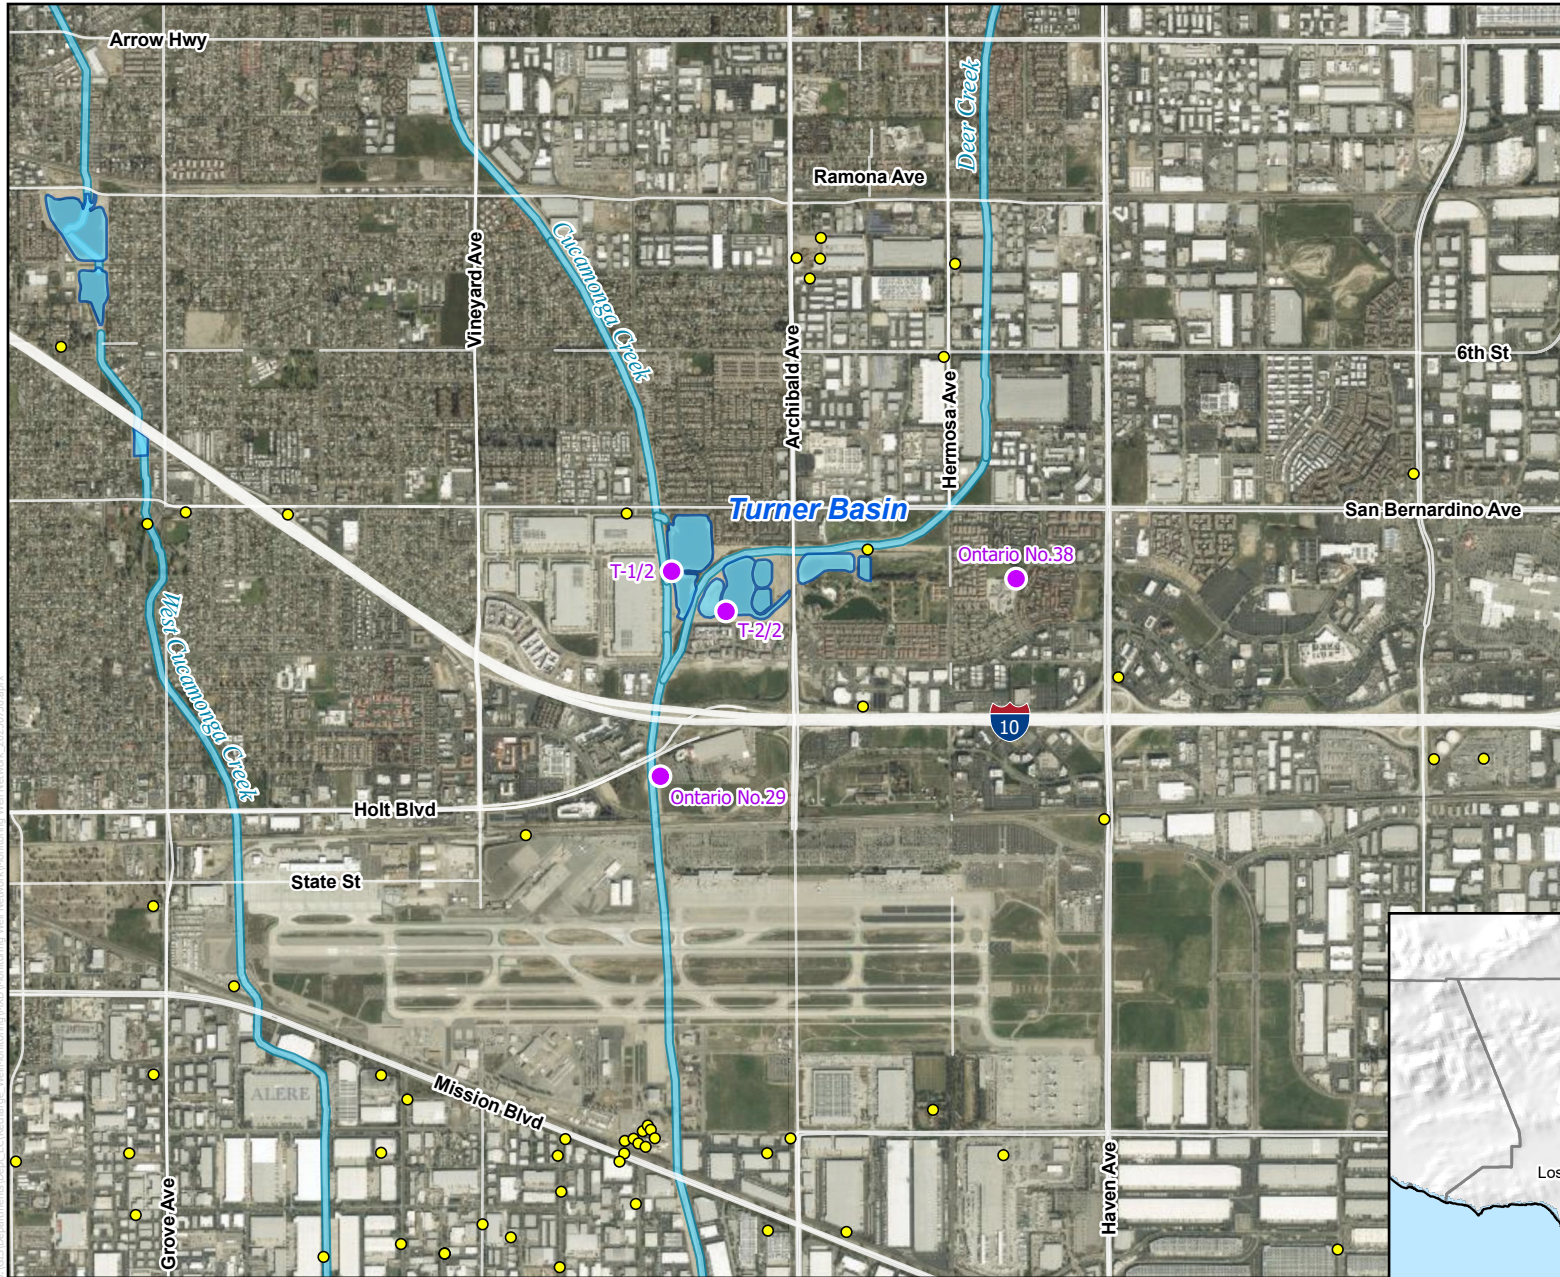

Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin




Monitoring Well Network


Turner Basin

Figure 2-2

Recycled Water Recharge Program



Date: 8/5/2025

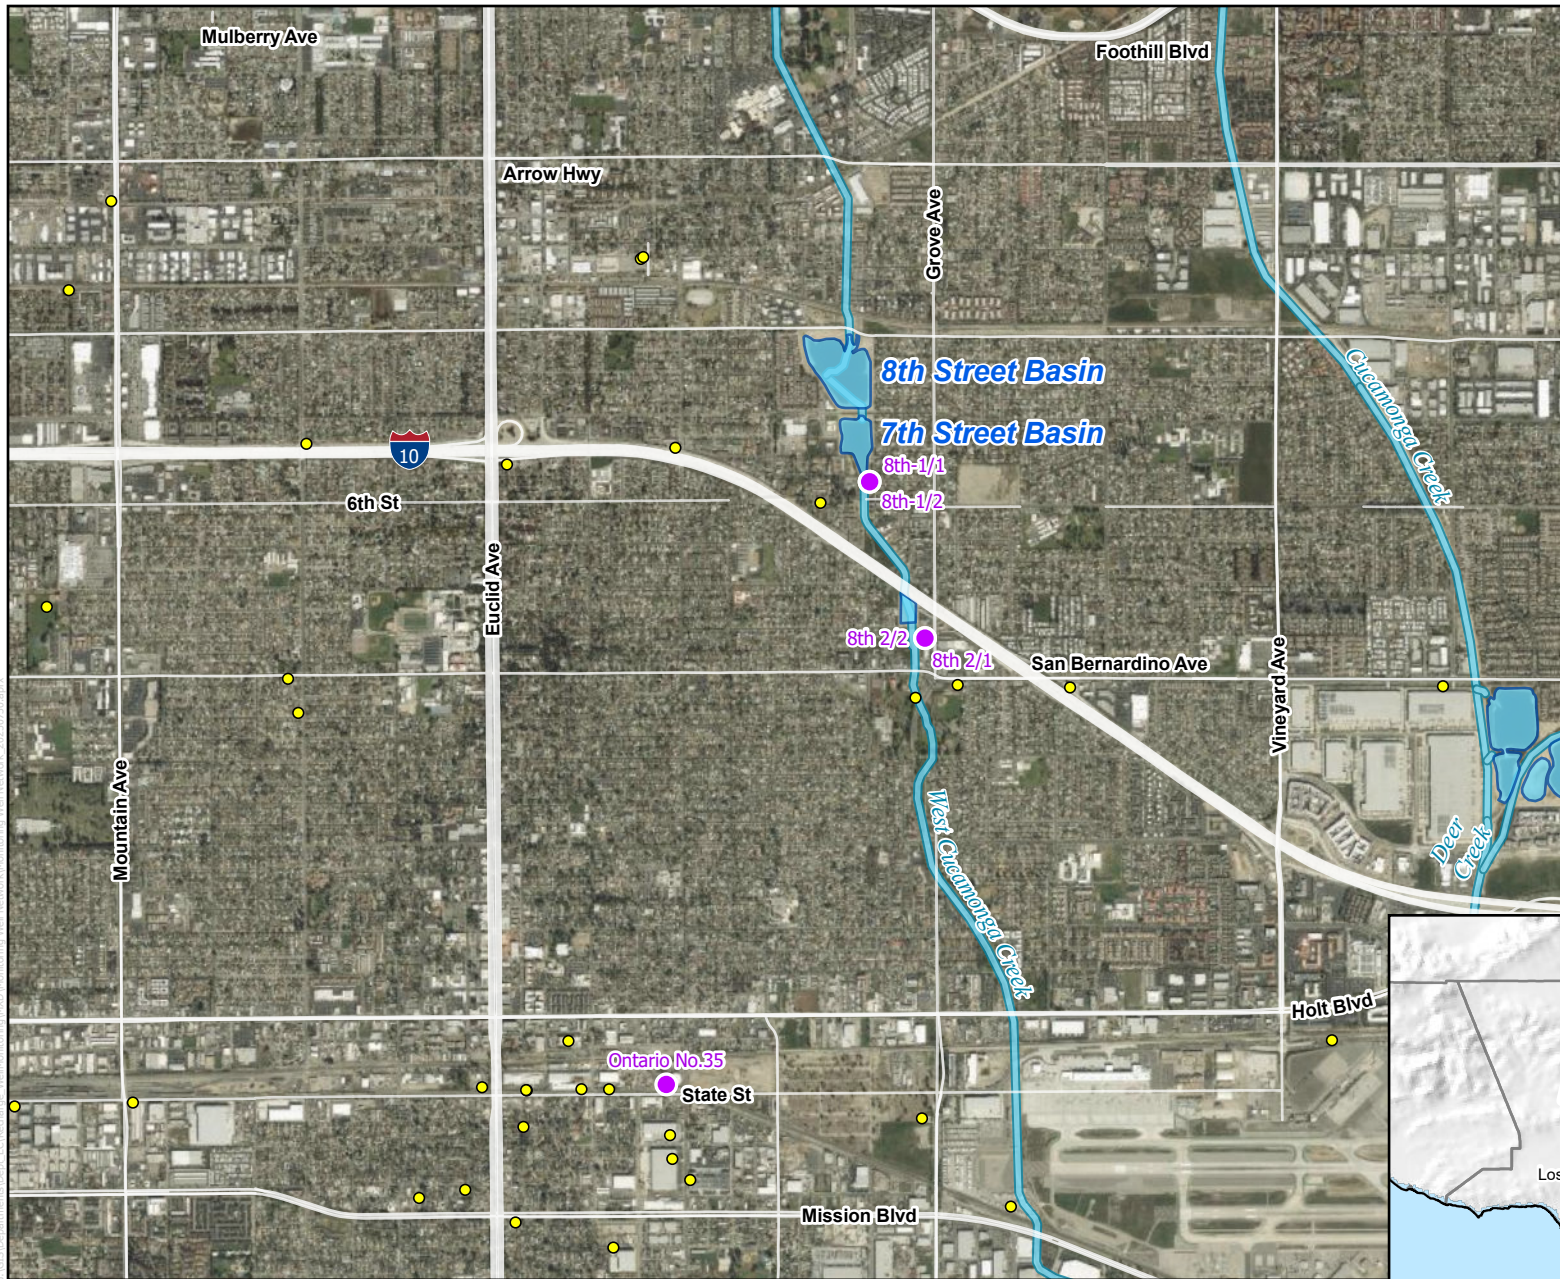

Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin




Monitoring Well Network


7th and 8th Street Basins

Figure 2-3

Recycled Water Recharge Program



Date: 8/5/2025

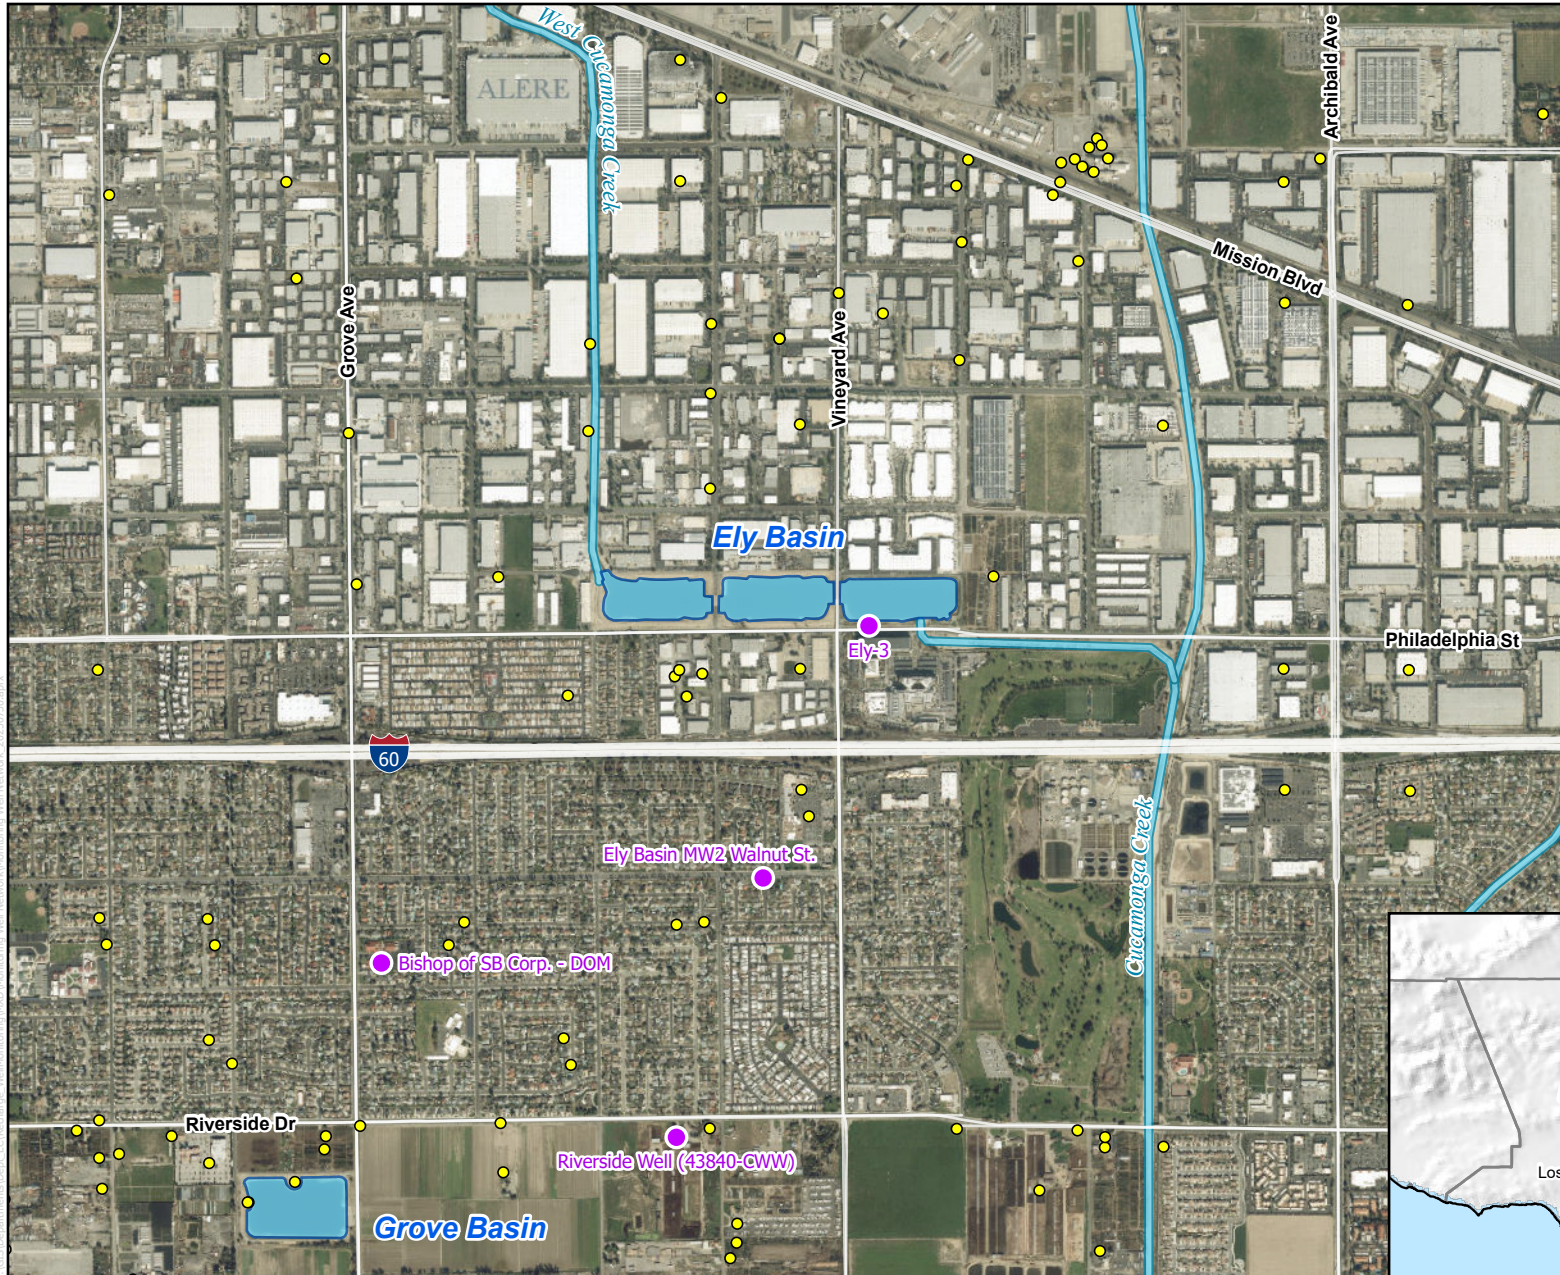

Main Map Features


- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin

Monitoring Well Network


Ely Basin

Figure 2-4

Recycled Water Recharge Program



Date: 8/6/2025

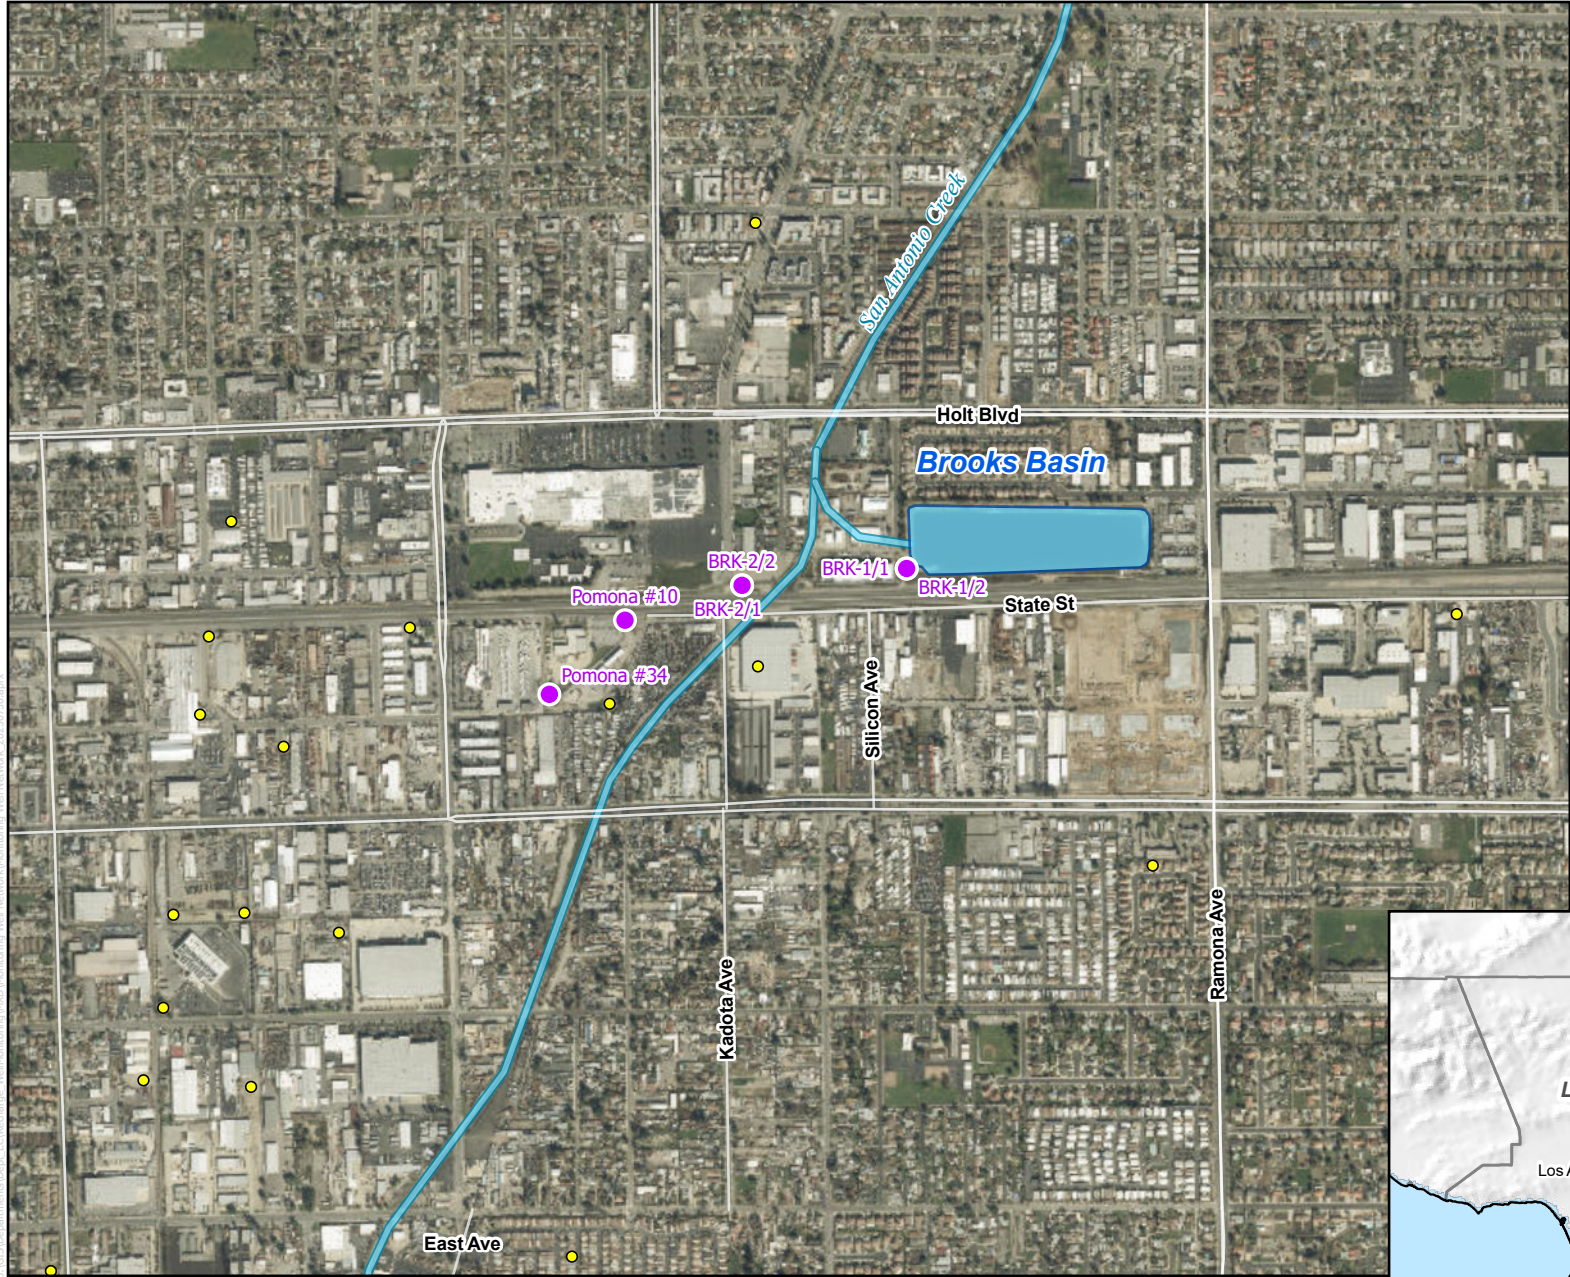

Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin




Monitoring Well Network


Brooks Basin

Figure 2-5

Recycled Water Recharge Program



Date: 8/5/2025

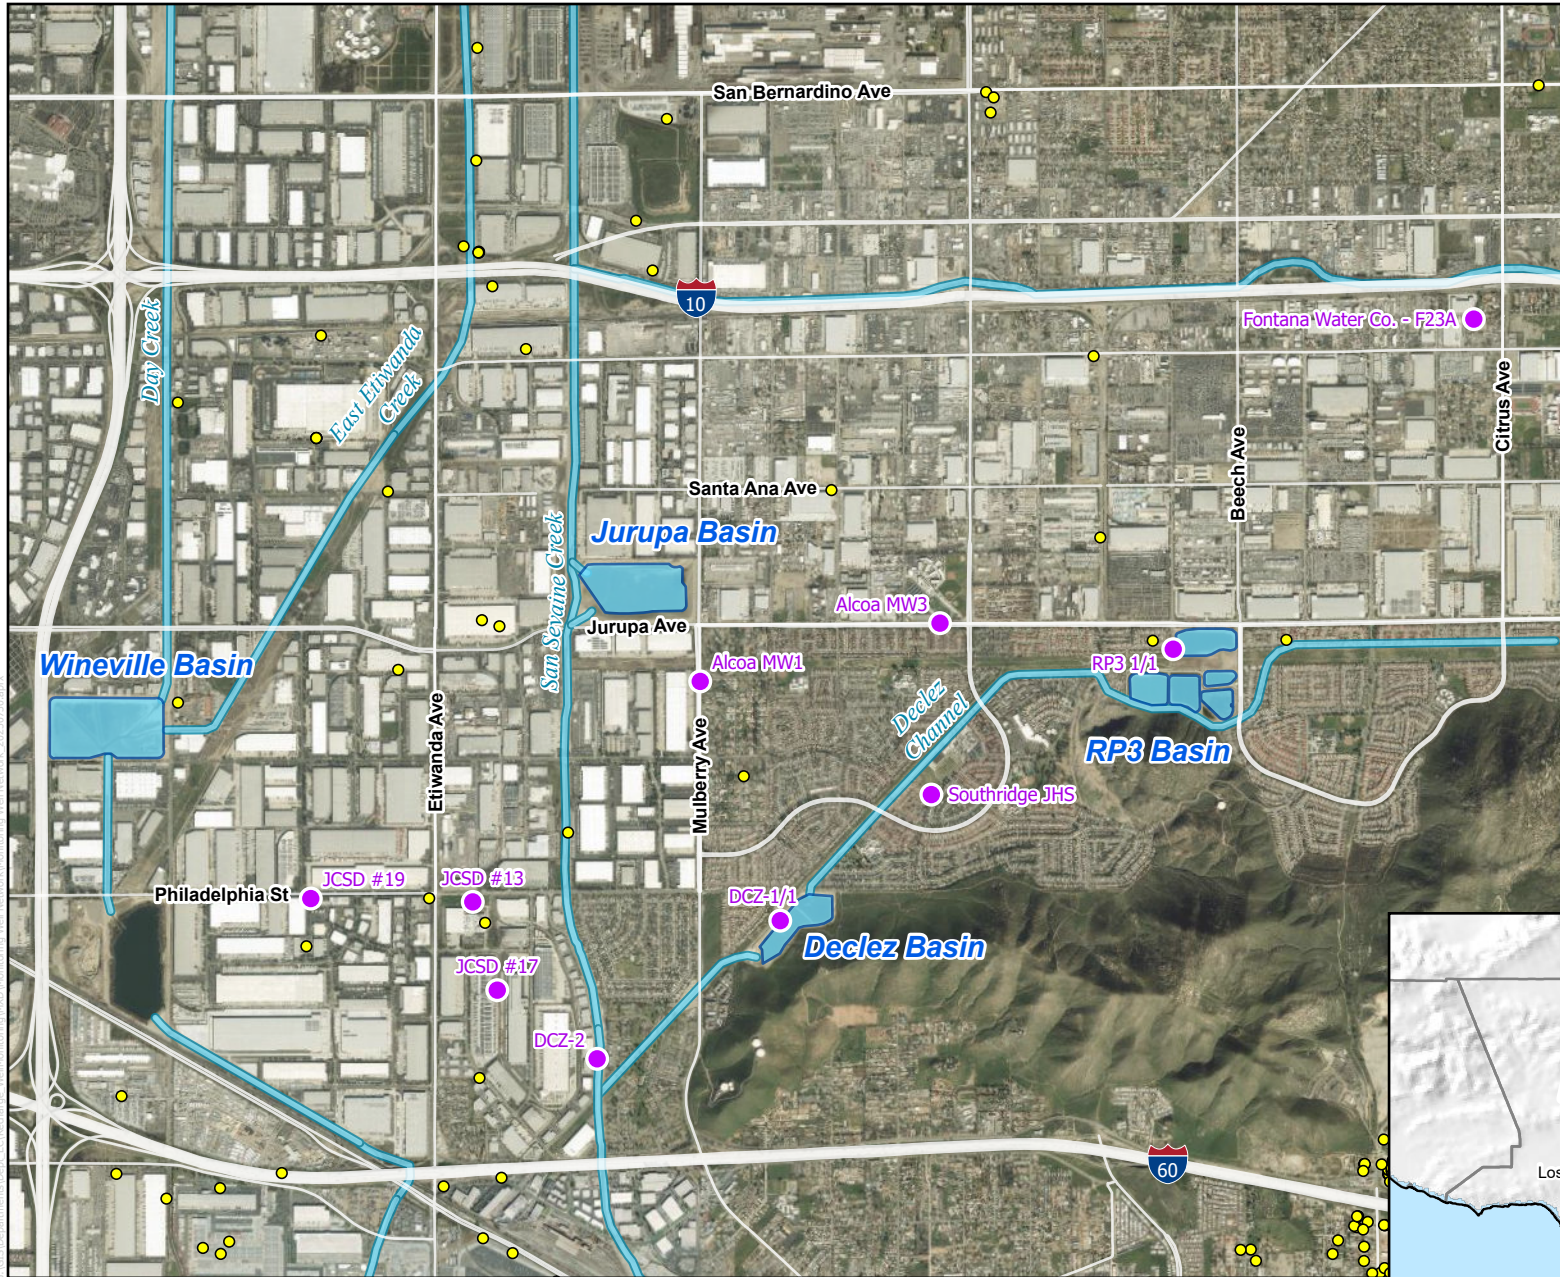


Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin

Monitoring Well Network
Declez and RP3 Basins

Figure 2-6

Recycled Water Recharge Program



Date: 8/6/2025



Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin




Monitoring Well Network

San Sevaïne and Victoria Basins

Figure 2-7

Recycled Water Recharge Program



Date: 8/5/2025